ADDENDUM #01

DATE: October 25, 2024

### TO CONTRACT DOCUMENTS ENTITLED:

General Site – Landscape Services Greenhouse Relocation and New Salt Shed

PROJECT NUMBER: CP231543

PREPARED FOR: THE CURATORS OF THE UNIVERSITY OF MISSOURI

CONSULTANT:

Crockett Engineering Consultants 1000 W. Nifong Blvd, Bldg #1 Columbia, Missouri 65203

Drawings and Specifications for the above noted project and the work covered thereby are herein modified as follows, and except as set forth herein, otherwise remain unchanged and in full force and effect:

#### **GENERAL INFORMATION:**

- 1. Clarify roof pitch shall be 2:12 as per plan sheets.
- 2. Clarify primer for metal building framing can meet either SSPC-20 or SSPC-15.
- 3. Clarify exterior and interior finishes of wall and roof of metal building shall be a galvanized steel wall panel with an acrylic coating, similar to MBCI's PBR panel coatings.
- 4. Clarify overhead door specification location to be found on plan sheet A100.

### SPECIFICATION CHANGES:


1. NONE

### DRAWING CHANGES:

- 1. MEP102
  - a. Clarify tap for FPHB is before blow down pit.

### END OF ADDENDUM #01

## ELECTRICAL PLAN SYMBOL LEGEND

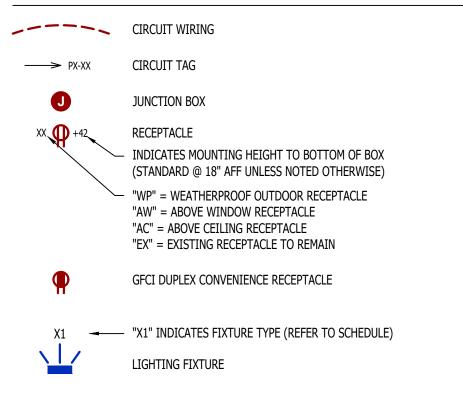

# **ELECTRICAL PLAN GENERAL NOTES:**

- 1. REFER TO E500 AND/OR E600 SERIES SHEETS FOR ADDITIONAL ELECTRICAL NOTES, DETAILS, REQUIREMENTS,
- AND SCHEDULES.
  2. ELECTRICAL CONTRACTOR SHALL REVIEW ALL PROJECT DOCUMENTS AND COORDINATE LOCATION OF ALL ELECTRICAL EQUIPMENT, WIRING, HANGERS / SUPPORTS, ETC. WITH HVAC AND PLUMBING TRADES BEFORE INSTALLATION OF ANY MATERIAL. ADDITIONAL COSTS ASSOCIATED WITH LACK OF COORDINATION WILL NOT BE
- REIMBURSED.
  ANY EXISTING ELECTRICAL EQUIPMENT, CIRCUITS, ETC. SHOWN IS FOR REFERENCE ONLY. ELECTRICAL CONTRACTOR TO FIELD VERIFY EXACT EQUIPMENT LOCATIONS, CONDITIONS, ETC. PRIOR TO BEGINNING WORK AND NOTIFY ENGINEER OF ANY DISCREPANCIES.

## **ELECTRICAL PLAN KEY NOTES:**

1 NEW NEMA 3R 120/208V, 3-PH 16 CIRCUIT 100 AMP MLO WITH 60-3 BREAKER INSTALLED IN SLOT 1,3,5 USED AS MAIN CIRCUIT BREAKER. INSTALL PERMANENT PLACARD ABOVE PANEL STATING THE FOLLOWING: <u>PANEL 'P1' -</u> (120/208V, 3-PH) DISCONNECT FOR PANEL IS LOCATED ON NORTH SIDE OF RRC BUILDING IN PANEL ADJACENT TO METER.

(2) POWER FOR OVERHEAD DOOR OPERATOR. COORDINATE EXACT LOCATION WITH OVERHEAD DOOR INSTALLER.

