

NATURAL GAS:

AMEREN MISSOURI

2001 MAGUIRE BLVD.

COLUMBIA, MO 65201

TELEPHONE:

BRIGHT SPEED

JARED HANES

SRO COLUMBIA, MO

UNIVERSITY OF MISSOURI, DIVISION OF I.T.

(573) 823-3962

615 LOCUST ST.

COLUMBIA, MO 65211 573-882-5000

FIBER:

573-876-3030

PROJECT BENCHMARKS:

TEMPORARY BENCHMARK (TBM) #1 - CHISELED SQUARE ON THE WEST SIDE OF THE LIGHT POLE BASE LOCATED JUST NORTH OF THE ALLEY, ON THE WEST SIDE OF HITT STREET. ELEVATION = 749.90

MU CONTROL POINT #MCP-002 N = 1134654.62E = 1690008.60ELEV. = 755.18

UTILITY COMPANIES:

LOCATES:

MISSOURI ONE CALL INC. 1022 B NORTHEAST DRIVE JEFFERSON CITY, MO 65109 1-800-344-7483

WATER/ELECTRIC/FIBER/SEWERMAIN:

CITY OF COLUMBIA P.O. BOX 6015 WATER & LIGHT DEPARTMENT COLUMBIA. MO 65205 573-874-2489

DATA/TELEVISION:

MEDIACOM 1211 WILKES BLVD COLUMBIA, MO 65201 (855) 633-4226

CHARTER COMMUNICATIONS 1510 CHARTER BOONE INDUSTRIAL BOULEVARD COLUMBIA, MO 65202 573-875-8875

SOCKET 573-817-0000

GENERAL NOTES:

ALL PUBLIC STREET, STORM DRAIN, AND SANITARY SEWER CONSTRUCTION TO BE IN ACCORDANCE WITH THE CITY OF

THERE IS NO REGULATED STREAM BUFFER WITHIN THE LIMITS OF THIS PROJECT AS DETERMINED BY THE USGS MAP

ANY FILL PLACEMENT WITHIN STREET RIGHT-OF-WAY SHALL BE INSPECTED BY THE CITY OF COLUMBIA.

COMPLETE THEIR PORTION OF WORK. THE DEVICES AND METHODS EMPLOYED WILL COMPLY WITH THE CURRENT VERSION OF THE "MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES" (MUTCD).

IN A CAREFUL AND PRUDENT MANNER, NOR SHALL IT EXCUSE SUCH PERSON FROM LIABILITY FOR ANY DAMAGE OR INJURY TO UNDERGROUND UTILITIES RESULTING FROM THE EXCAVATION.

IT IS THE INTENT OF THESE PLANS TO COMPLY WITH THE REQUIREMENTS OF THE MODNR CLEAN WATER COMMISSION.

THE CONTRACTOR IS RESPONSIBLE FOR MAINTAINING ALL EROSION CONTROL DEVICES AND REMOVING THEM ONCE THE

CONTRACTOR TO PROTECT ALL EXISTING UTILITIES, STRUCTURES, AND PAVEMENT THAT IS TO REMAIN. ALL DAMAGED ITEMS OUTSIDE THE SCOPE OF WORK TO BE REPLACED OR REPAIRED TO ORIGINAL CONDITION AT THE CONTRACTORS

ALL PAVEMENTS, SIDEWALKS, ABANDONED SEWERS, PIPELINES, EXCESS EARTHWORK, OR OTHER OBSTRUCTIONS TO CONSTRUCTION THAT ARE REMOVED SHALL BECOME THE PROPERTY OF THE CONTRACTOR UNLESS SPECIFICALLY NOTED AND SHALL BE DISPOSED OF BY THE CONTRACTOR IN ACCORDANCE WITH STATE REGULATION 10 CSR 80-2.010

ALL SLOPES ARE 3:1 OR FLATTER UNLESS OTHERWISE NOTED.

ALL DISTURBED AREAS WITHIN THE "LIMITS OF DISTURBANCE" THAT ARE NOT TO BE PAVED, SHALL BE FINE GRADED BY CONTRACTOR TO AN ELEVATION OF 6" BELOW FINISHED GRADE FOR TURF AREAS AND 24" BELOW FINISHED GRADE FOR PLANTER AREAS. TOP SOIL AND VEGETATION WILL BE REESTABLISHED BY OWNER.

TOTAL DISTURBED AREA = 0.22 AC.

MISSOURI DNR LAND DISTURBANCE PERMIT NOT NEEDED FOR THIS PROJECT.

ALL WORK SHALL BE SCHEDULED WITH THE OWNER'S REPRESENTATIVE AND BE SUBJECT TO THE OWNER'S APPROVAL PRIOR TO PROCEEDING.

SPECIAL INSPECTIONS:

THE FOLLOWING ITEMS REQUIRE SPECIAL INSPECTION IN ACCORDANCE WITH CHAPTER 17 OF THE INTERNATIONAL BUILDING CODE:

PLACING OF CONCRETE AND REINFORCING STEEL (CONTINUOUS OF CONCRETE SAMPLING / PERIODIC OF REINFORCING)

IN-SITU SOILS, EXCAVATIONS, FILLING & COMPACTION (PERIODIC)

THE CONTRACTOR SHALL REQUEST SPECIAL INSPECTION OF THE ITEMS LISTED ABOVE PRIOR TO THOSE ITEMS BECOMING INACCESSIBLE AND UNOBSERVABLE DUE TO PROGRESSION OF THE WORK.

DEFERRED SUBMITTALS:

NONE.

ENGINEER CERTIFICATION:

BY SIGNING AND AFFIXING MY SEAL TO THESE PLANS, I HEREBY CERTIFY THESE DRAWINGS AND/OR SPECIFICATIONS HAVE BEEN PREPARED BY ME, OR UNDER MY SUPERVISION. FURTHER CERTIFY THAT TO THE BEST OF MY KNOWLEDGE THESE DRAWINGS AND/OR

FLOOD PLAIN STATEMENT:

NO PART OF THIS TRACT IS LOCATED WITHIN THE 100-YEAR FLOODPLAIN AS PER THE BOONE COUNTY FIRM MAP #2900340280E DATED APRIL 19, 2017.

CITY OF COLUMBIA WORK NOTES:

1. CONTRACTOR IS RESPONSIBLE FOR OBTAINING A CITY RIGHT OF WAY PERMIT TO PERFORM WORK WITHIN CITY OF COLUMBIA RIGHT OF WAY FOR WORK SHOWN. 2. CONTRACTOR IS RESPONSIBLE FOR NOTIFYING CITY INSPECTORS AND PERSONNEL AS PART OF THEIR WORK WITHIN CITY RIGHT OF WAY.

APPLICABLE CODES:

- International Building Code 2021
- International Plumbing Code 2021 International Mechanical Code - 2021
- International Fire Code 2021
- ICC A117.1 Accessible and Usable Buildings and Facilities -2017 (all sections are now applicable)
- National Electric Code/NFPA 70 2020
- NFPA 51B Standard for Fire Prevention During Welding, Cutting, and Other
- Americans with Disabilities Act Standards for Accessible Design 2010

Number	Greet the		TILVIOIOIV
CE 0	COVER SHEET	X	
CE 1	DEMOLITION PLAN	X	
CE 2	EROSION CONTROL PLAN	X	
CE 3	GRADING PLAN	X	
CE 4	SITE PLAN	X	
CE 5	SITE CONSTRUCTION DETAILS	Х	
CE 6	CITY DETAILS 1 OF 2	Х	
CE 7	CITY DETAILS 2 OF 2	Х	
CE 8	BASE BID PHASE 1 SIDEWALK CLOSURE PLAN	Х	
CE 9	BASE BID PHASE 1 SOUTH SEWER TRAFFIC CONTROL PLAN	Х	
CE 10	BASE BID PHASE 1 EAST WATER TRAFFIC CONTROL PLAN	Х	
CE 11	ALT#1 PHASE 2 SIDEWALK CLOSURE PLAN	Х	

ALT#1 PHASE 3 SIDEWALK CLOSURE PLAN

GENERAL STRUCTURAL DATA

RETAINING WALL SITE PLAN

RETAINING WALL PROFILE

RETAINING WALL DETAILS

BID SET REVISION

EXISTING LIGHT POLE

EXISTING GUY WIRE

PEDESTRIAN GUARDRAIL FENCING AT RETAINING WALL

----- × ----- CONSTRUCTION BARRIER FENCING

LEGEND OF SYMBOLS:

---- OUTER STREAM BUFFER

— SILT FENCE

Sheet List Table

LEGEND OF	· SYMBOLS:		
	EXISTING CURB	FF=XXX.X	FINISH FLOOR OF STRUCTURE
	PROPOSED CURB	(XXX.XX TC)	PROPOSED TOP OF CURB ELEVATION
	RIP RAP	(XXX.XX TP)	PROPOSED TOP OF PAVEMENT ELEVATION
	EXISTING STRUCTURE	(XXX.XX FG)	PROPOSED FINISH GRADE ELEVATION
	EXISTING TREELINE	(XXX.XX TW)	PROPOSED TOP OF WALL
~~~~	PROPOSED TREELINE	XX	LOT NUMBER
	EDGE OF WATERWAY		
w	EXISTING WATERLINE	$\langle \chi \rangle$	STORM SEWER STRUCTURE LABEL
w	PROPOSED WATERLINE	$\overline{V}$	CANITADY OF WED OTDUOTUDE LADEL
—	EXISTING GAS LINE	X	SANITARY SEWER STRUCTURE LABEL
G	PROPOSED GAS LINE	H.P.	HIGH POINT
- $ -$ UT $ -$	EXISTING UNDERGROUND TELEPHONE	L.P.	LOW POINT
- $ -$ UTV $ -$	EXISTING UNDERGROUND CABLE TELEVISION	<del>_</del>	EXISTING SIGNS
— — – HVE— — —	EXISTING HIGH VOLTAGE ELECTRIC	Ø	EXISTING POWER POLE
—— OE ——	EXISTING OVERHEAD ELECTRIC	GV	EXISTING CAS VALVE
$   \mathrm{UE}$ $ -$	EXISTING UNDERGROUND ELECTRIC	$\bowtie$	EXISTING WATER VALVE
——— OETV ———	EXISTING OVERHEAD ELEC. & TV	©	EXISTING WATER VALVE
— — OETVT — —	EXISTING OVERHEAD ELEC., TV & TELE.	W	EXISTING WATER METER
—— s ——	EXISTING SANITARY SEWER	À	EXISTING WATER METER  EXISTING FIRE HYDRANT
—— s ——	PROPOSED SANITARY SEWER	<b>∀</b> ⊚	MANHOLE
·····XXX······	EXISTING MINOR CONTOUR	•	EXISTING SANITARY SEWER LATERAL
XXX	EXISTING MAJOR CONTOUR		
XXX	PROPOSED MINOR CONTOUR		PROPOSED SANITARY SEWER LATERAL
XXX	PROPOSED MAJOR CONTOUR	(B)	PROPOSED TRACER WIRE TEST STATION BOX
	100 YEAR FLOOD PLAIN	AC	EXISTING AIR CONDITIONER
ППППППП	FLOODWAY		EXISTING TELEPHONE PEDESTAL
··	ORDINARY HIGH WATER MARK	町	EXISTING ELECTRICAL TRANSFORMER
<del></del>	STREAM SIDE BUFFER	E	EXISTING ELECTRIC METER

THIS SHEET HAS BEEN SIGNED, SEALED ANI

REVISIONS:

ANDREW T. GREENE MO LICENSE-2020000043

BUILDING

DEMOLISH 四四 S

209 207


DRAWING INCLUDES:


**COVER SHEET** 


DESIGNED: ATG


DRAWN: ATG PROJECT NO.: 230464


SHEET:

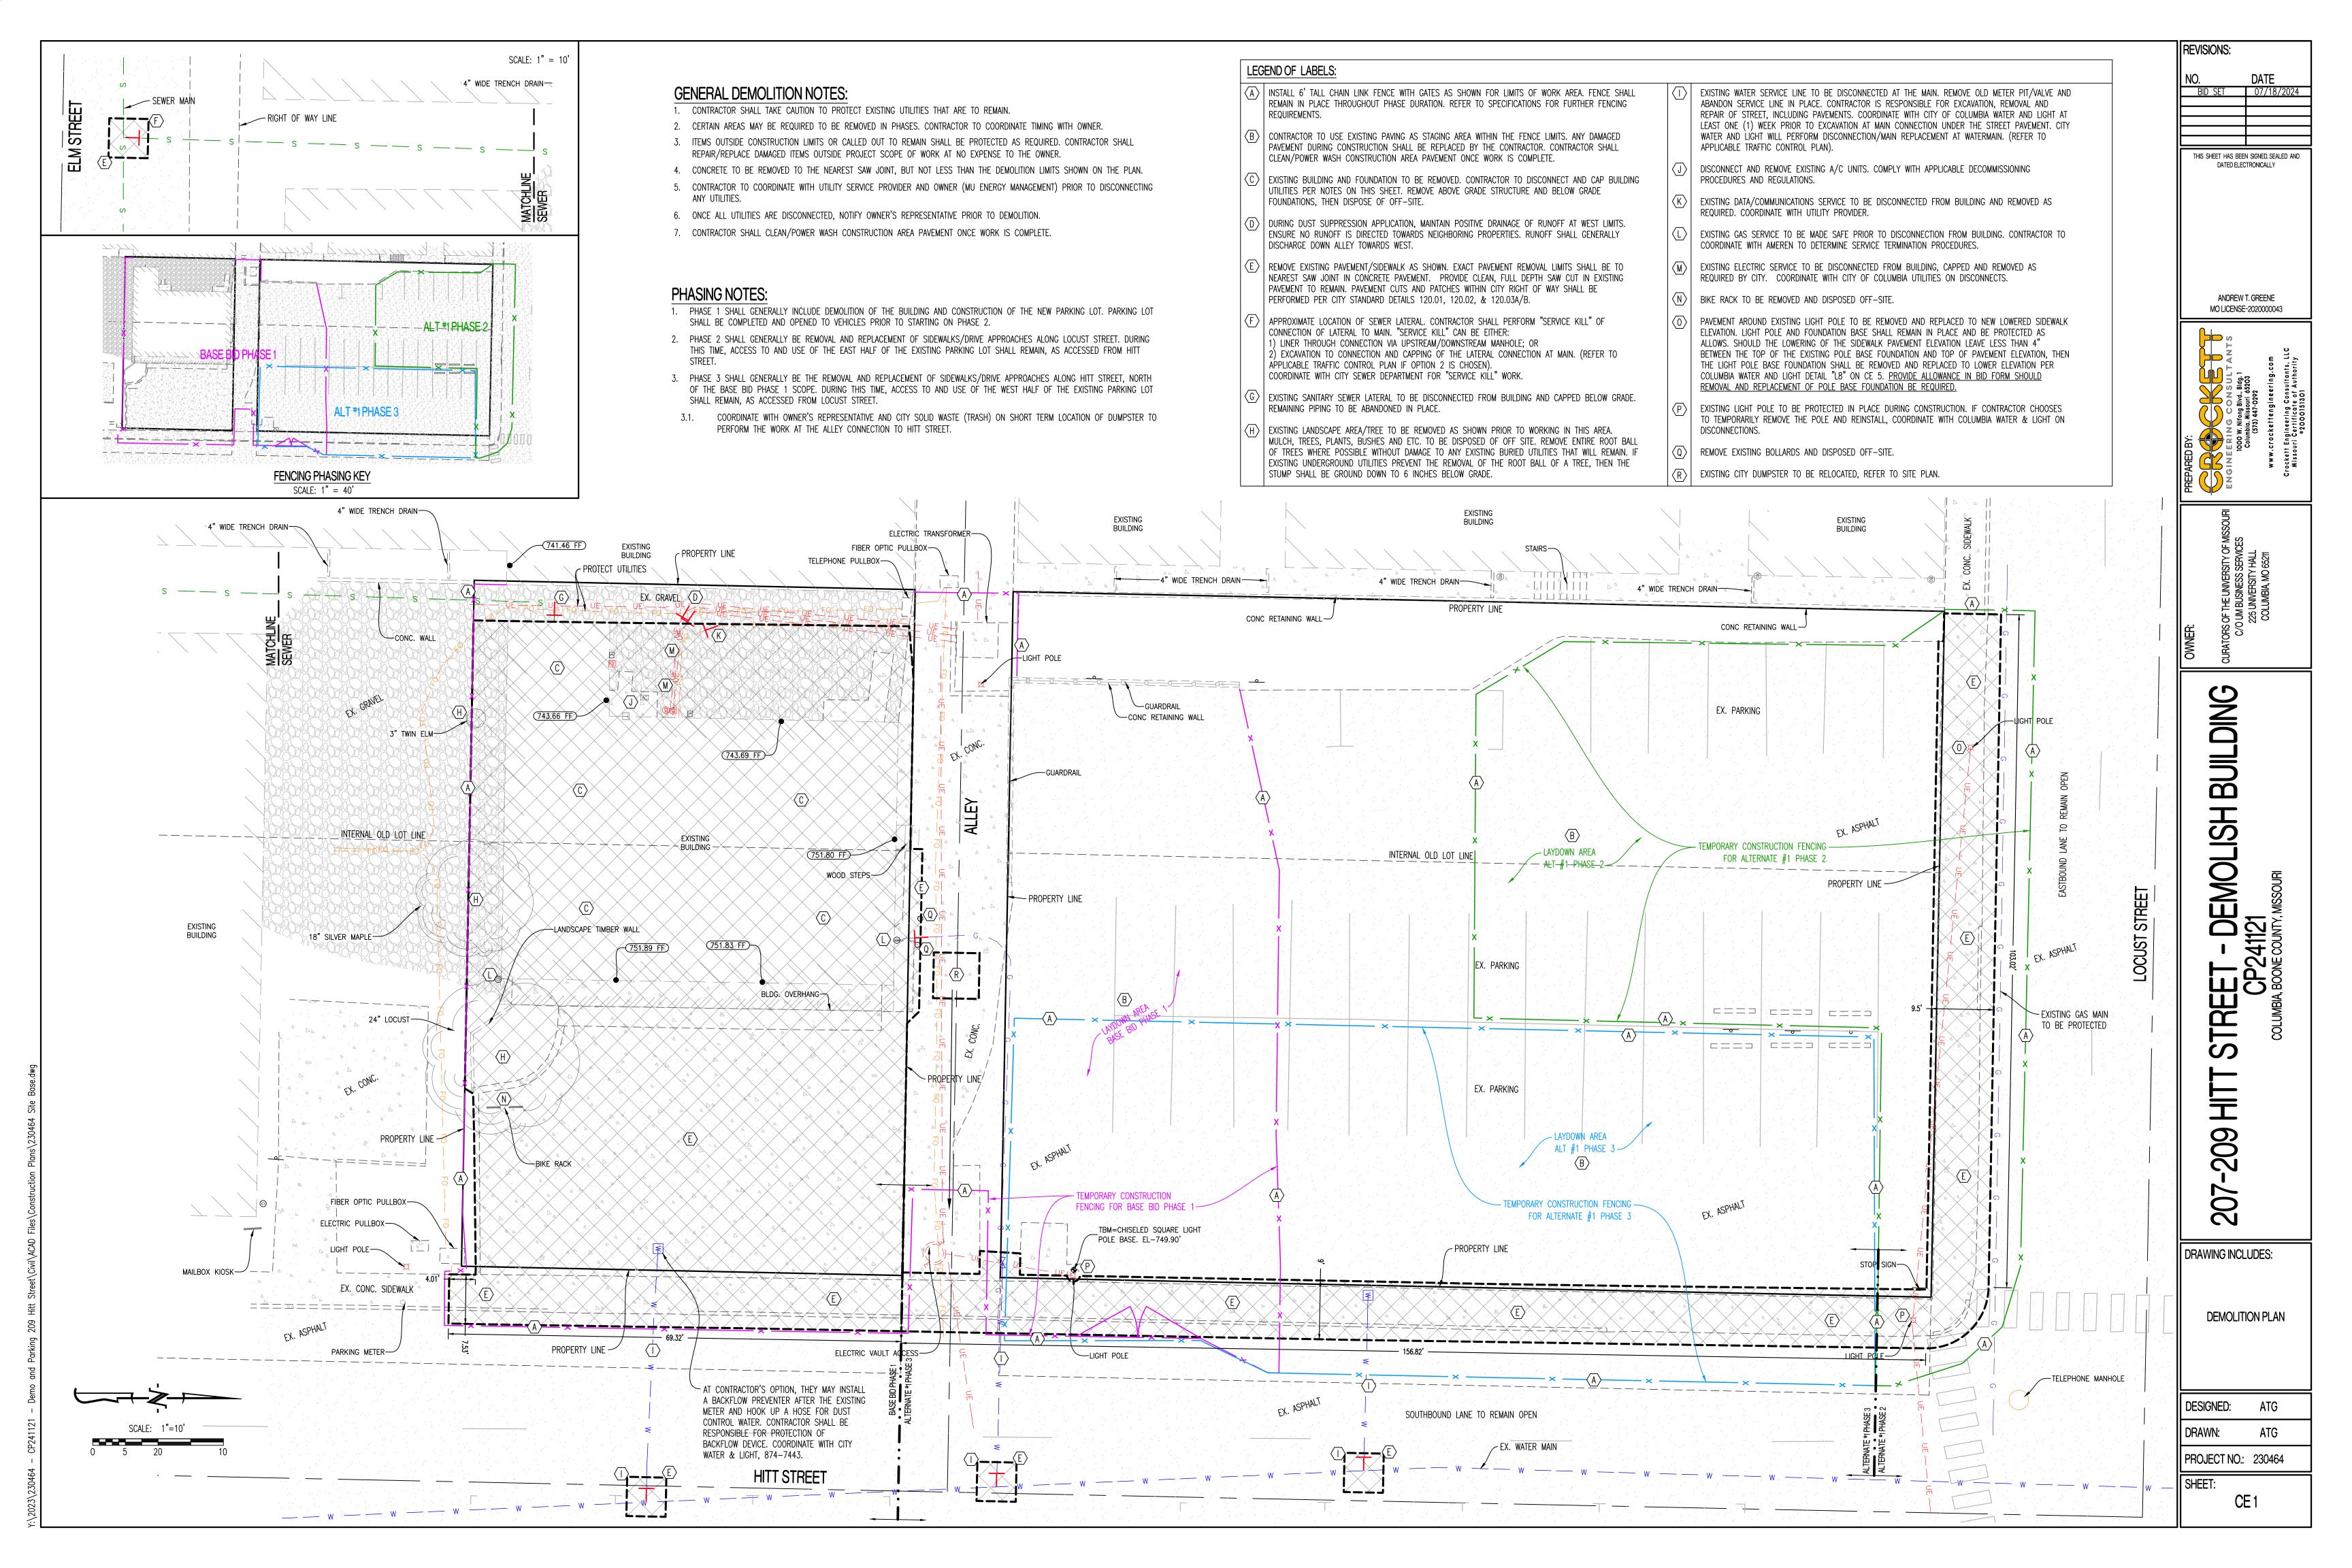

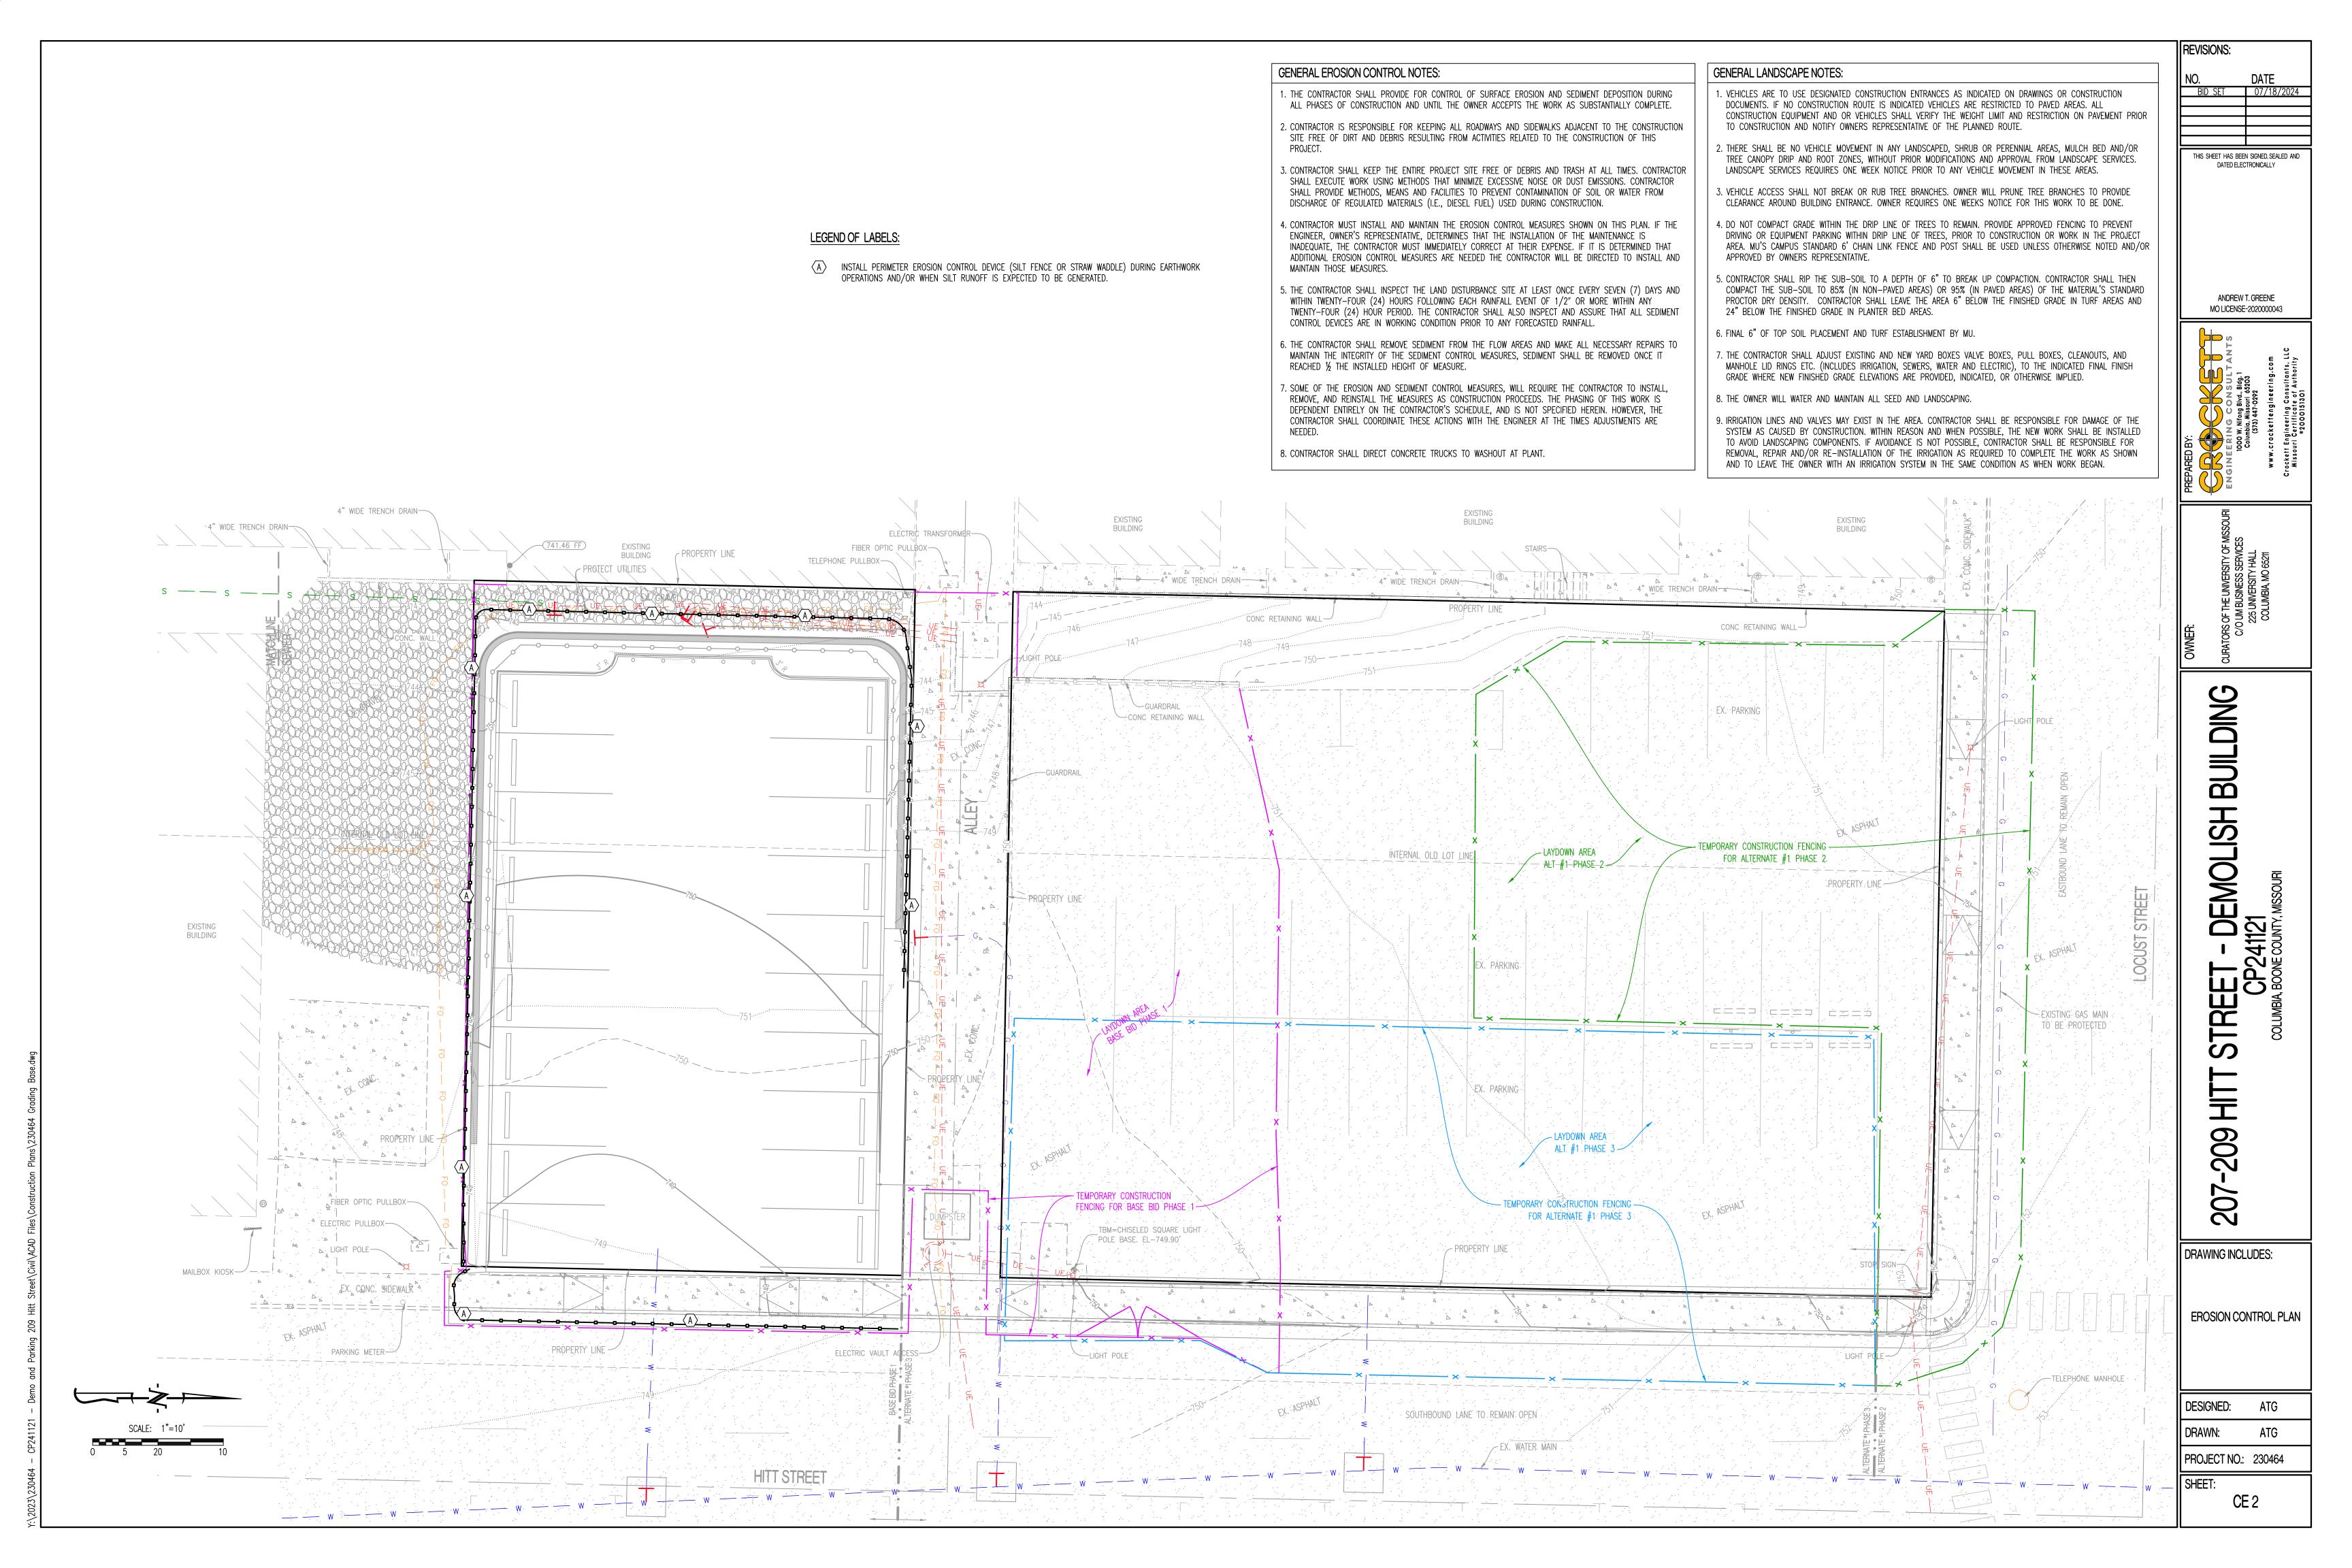

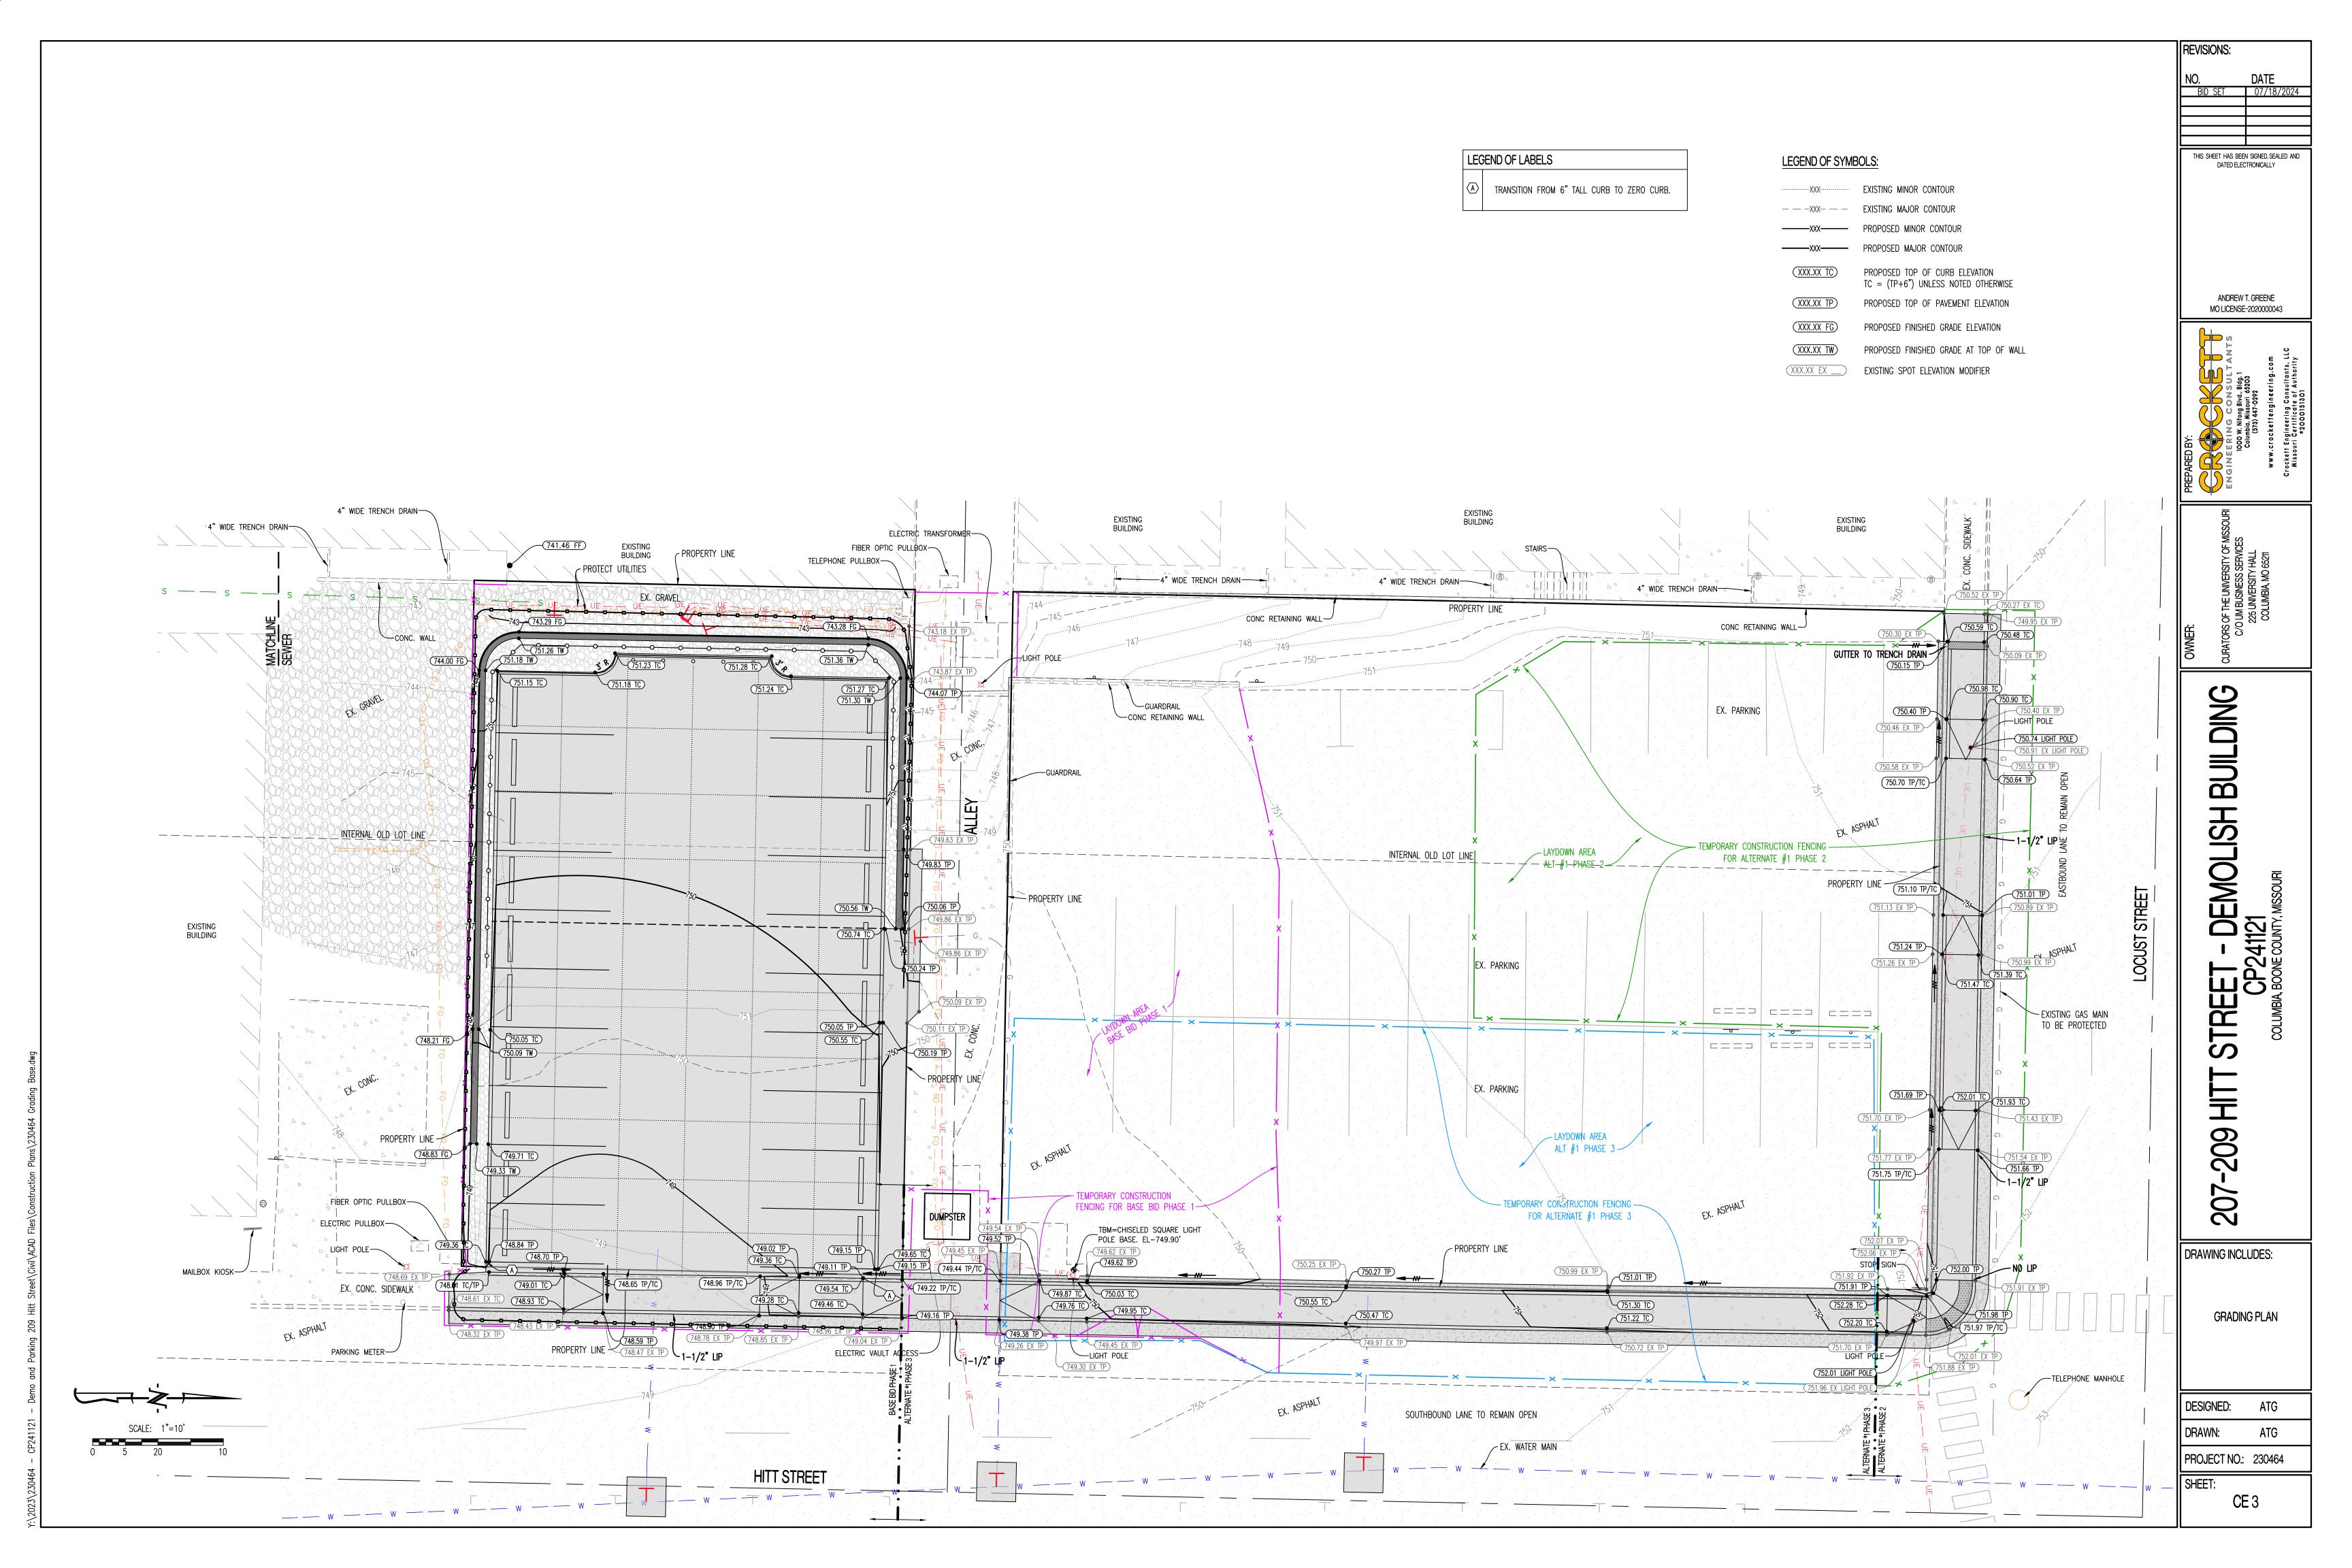

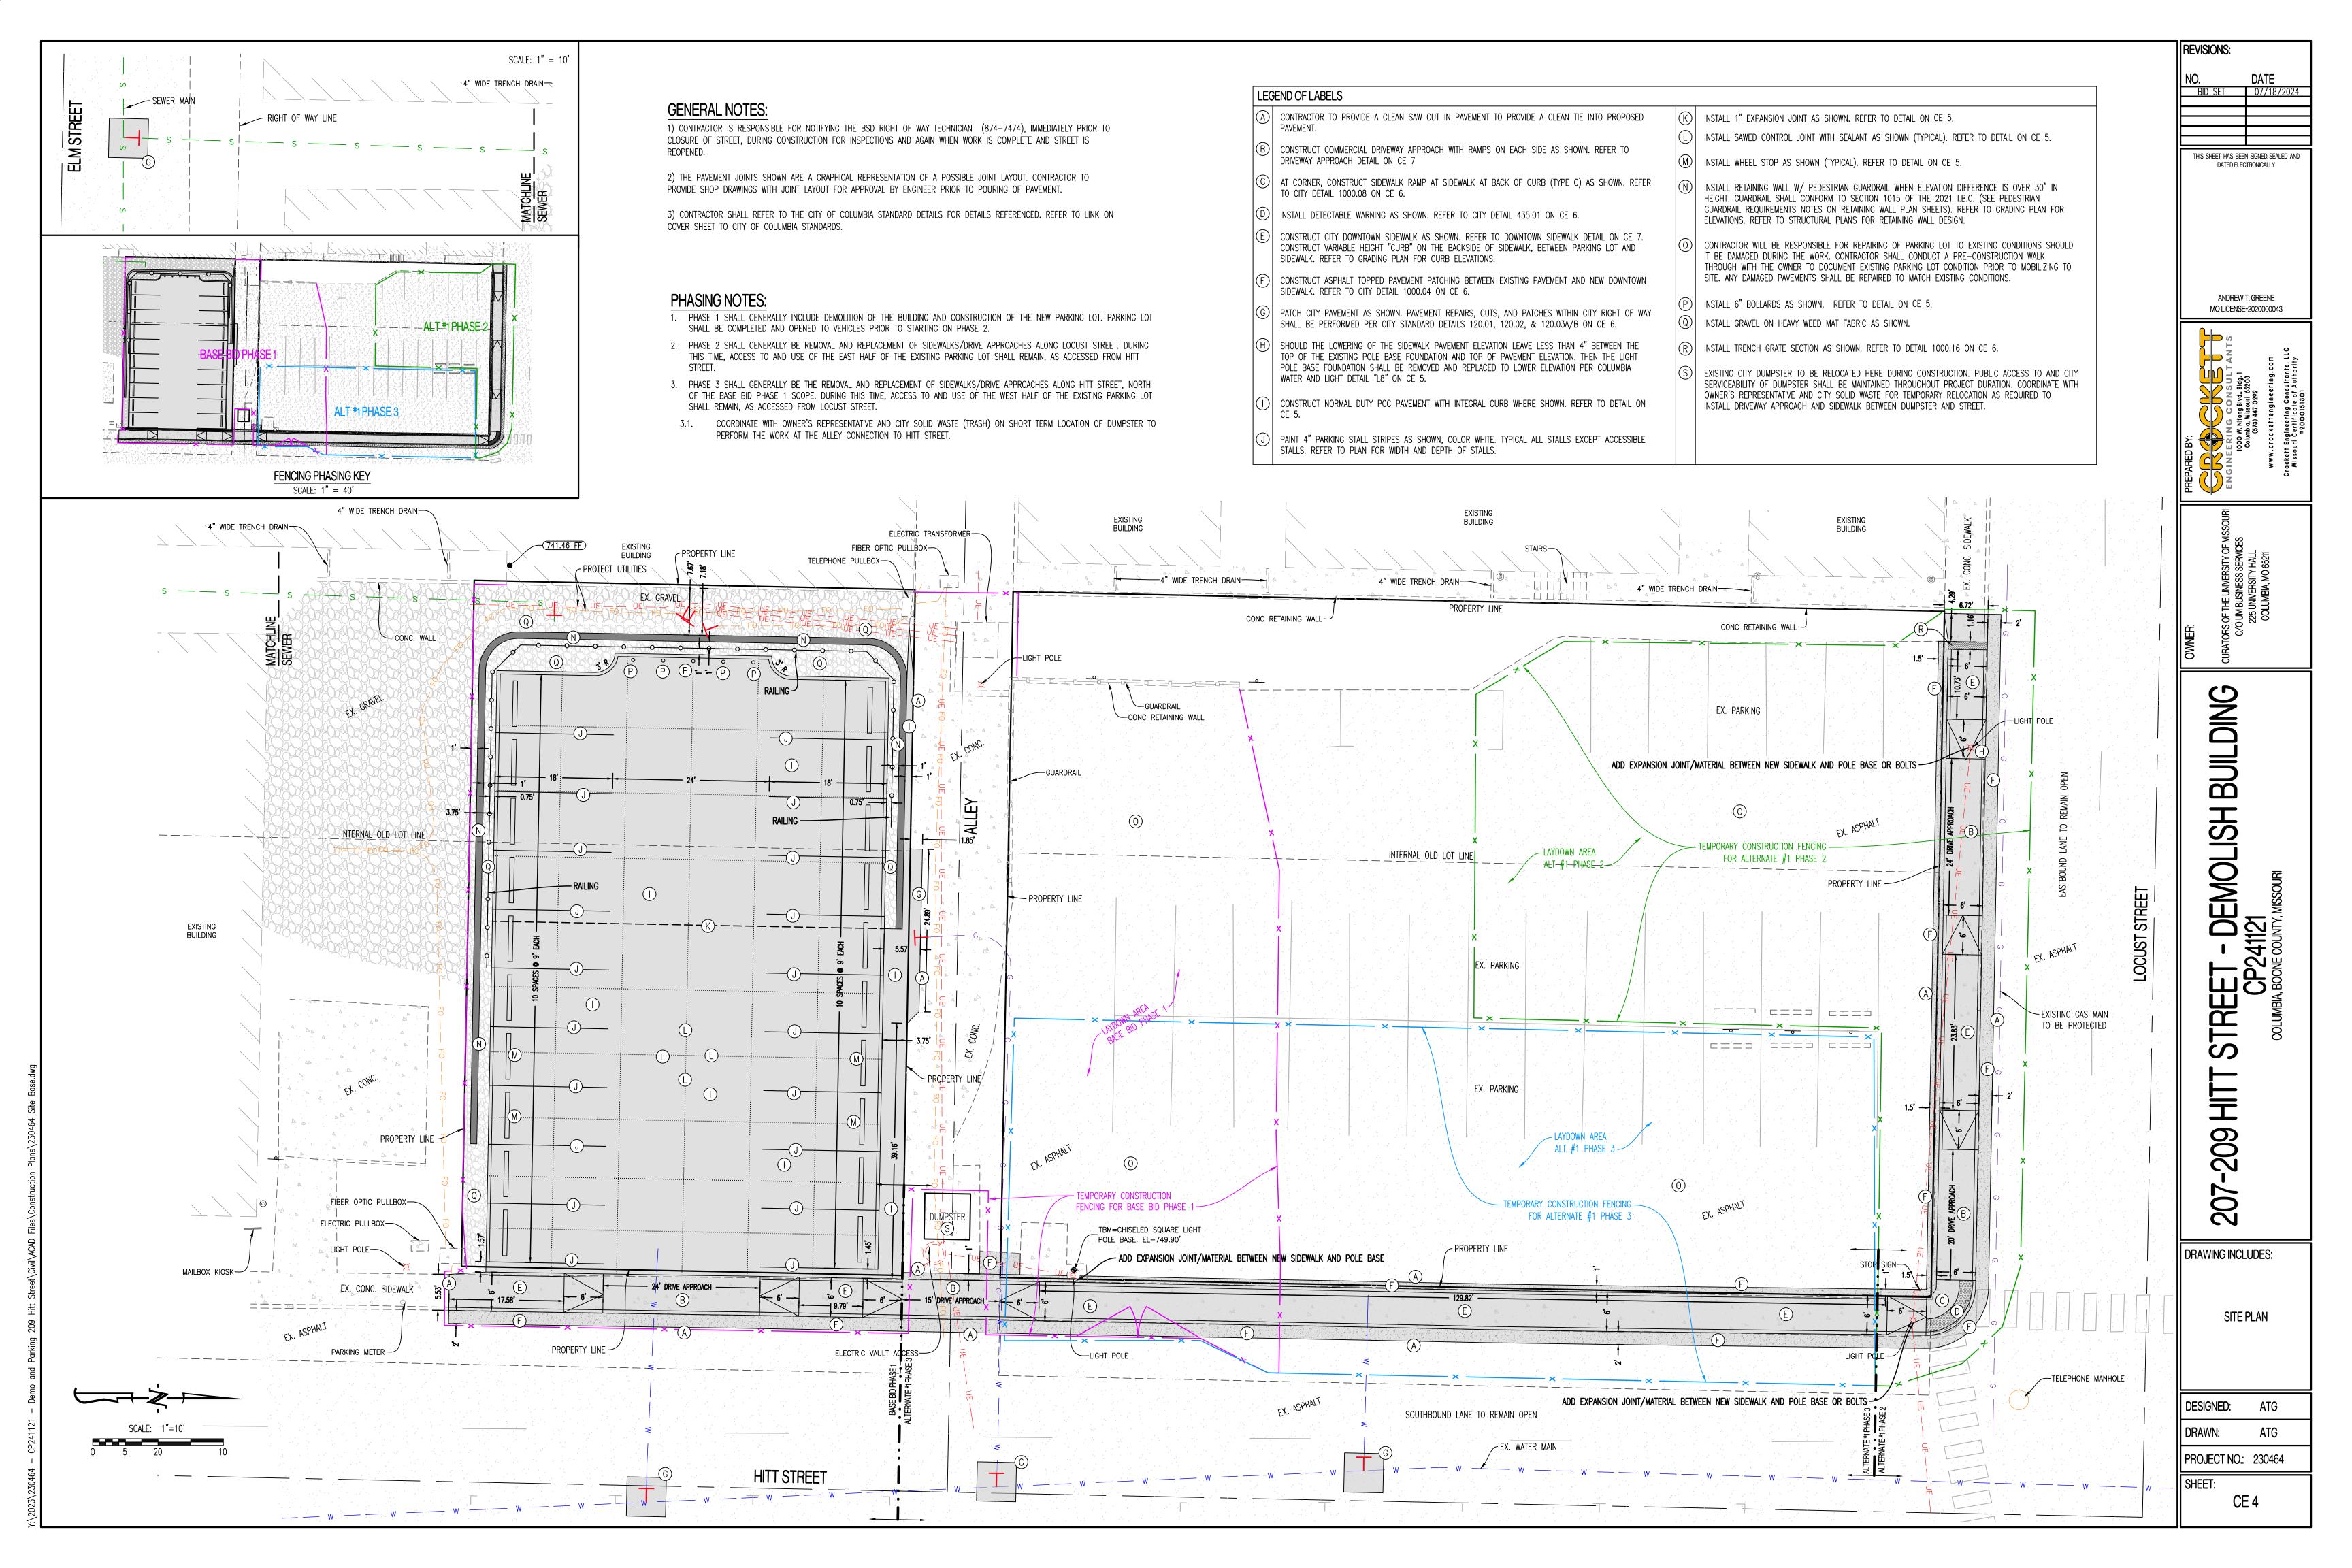

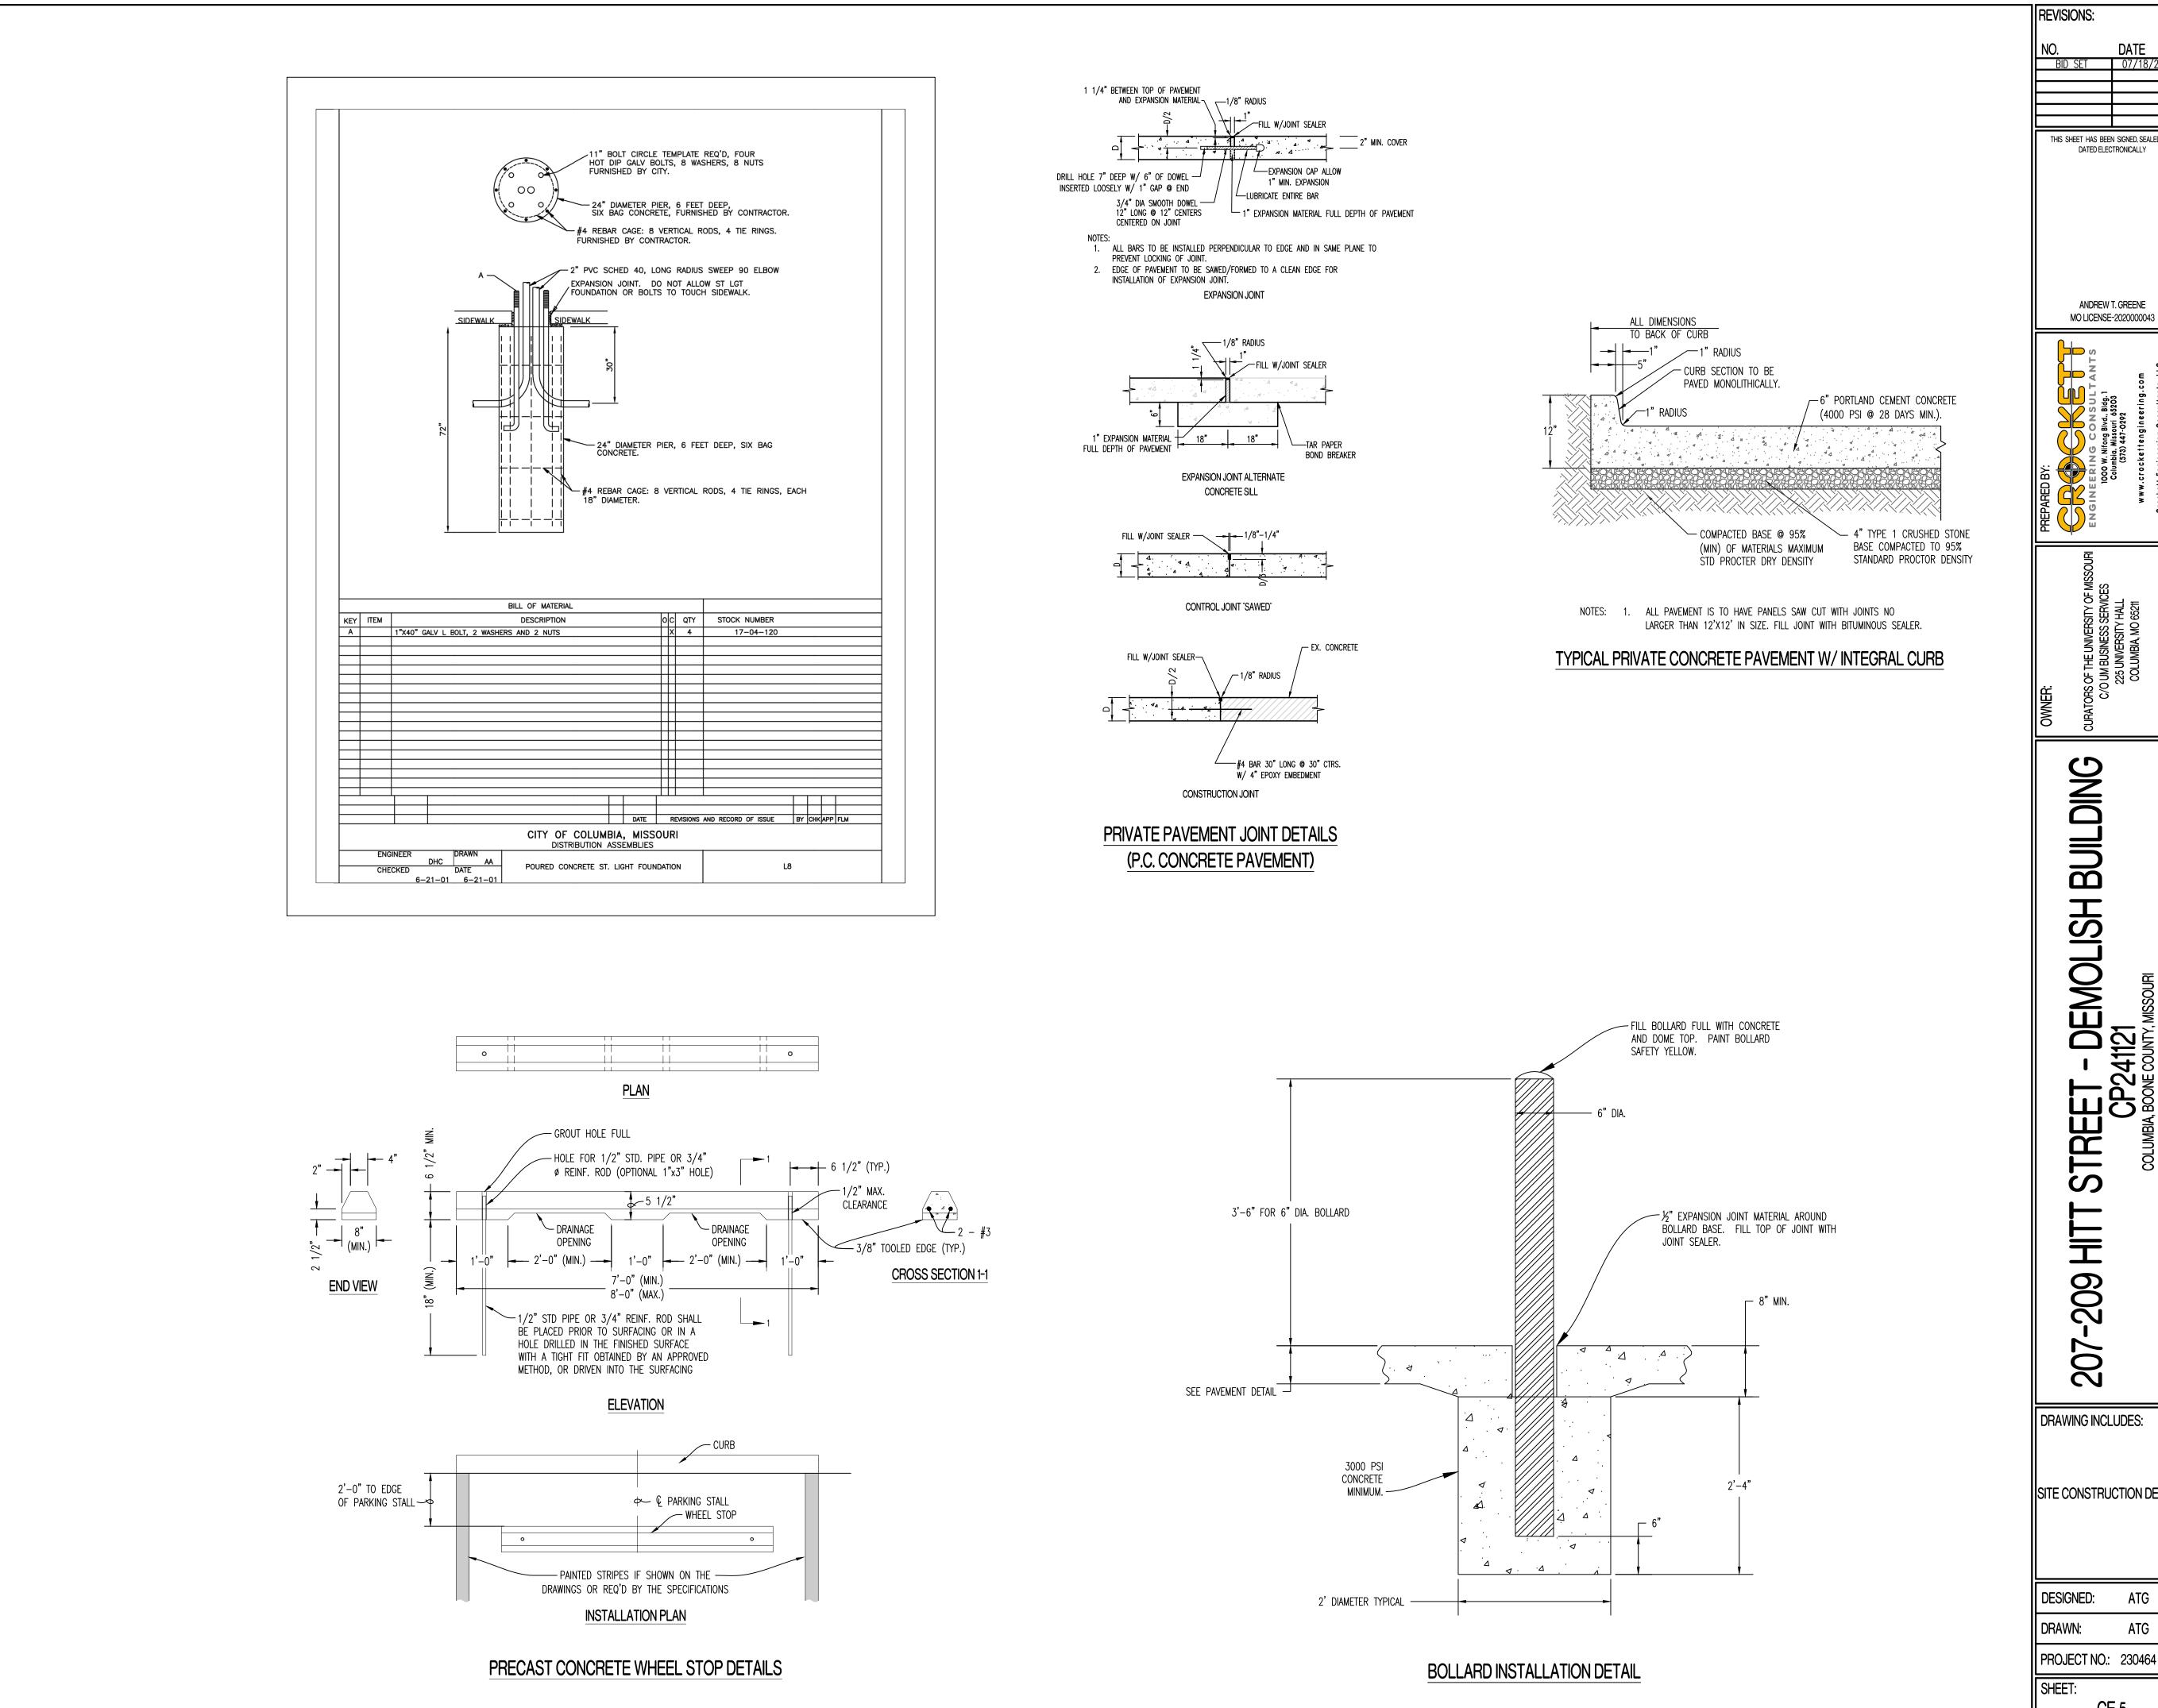


BID SET 07/18/2024 THIS SHEET HAS BEEN SIGNED, SEALED AND DATED ELECTRONICALLY


ANDREW T. GREENE MO LICENSE-2020000043


SITE CONSTRUCTION DETAILS

ATG

PROJECT NO.: 230464

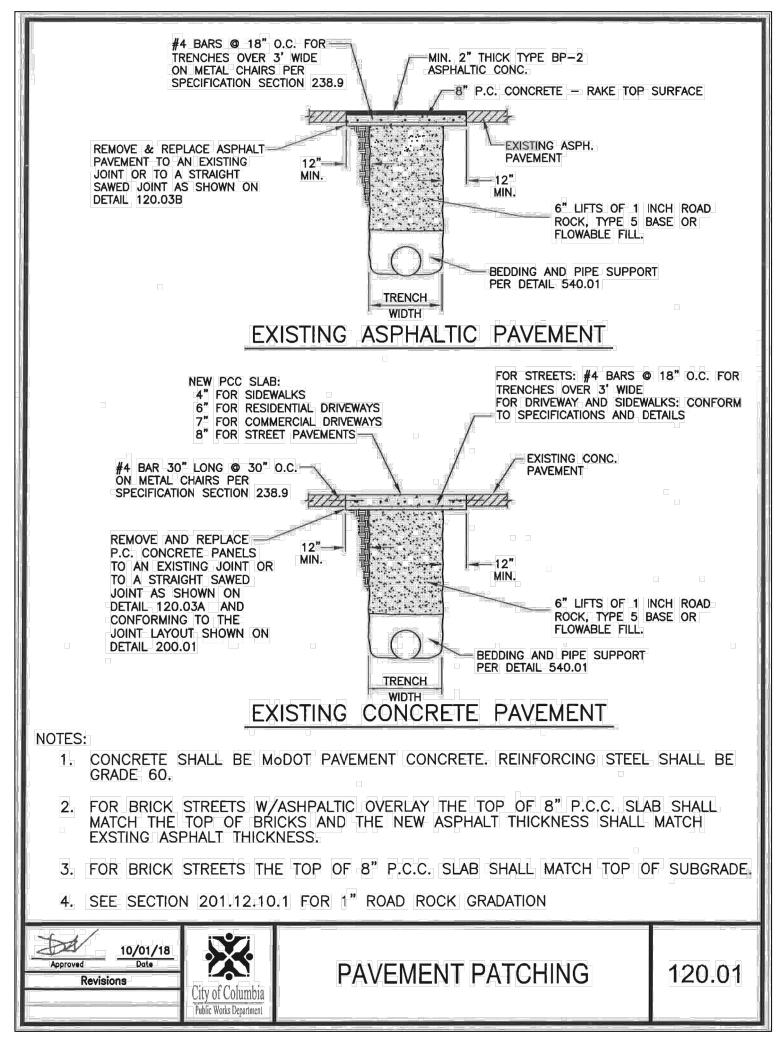

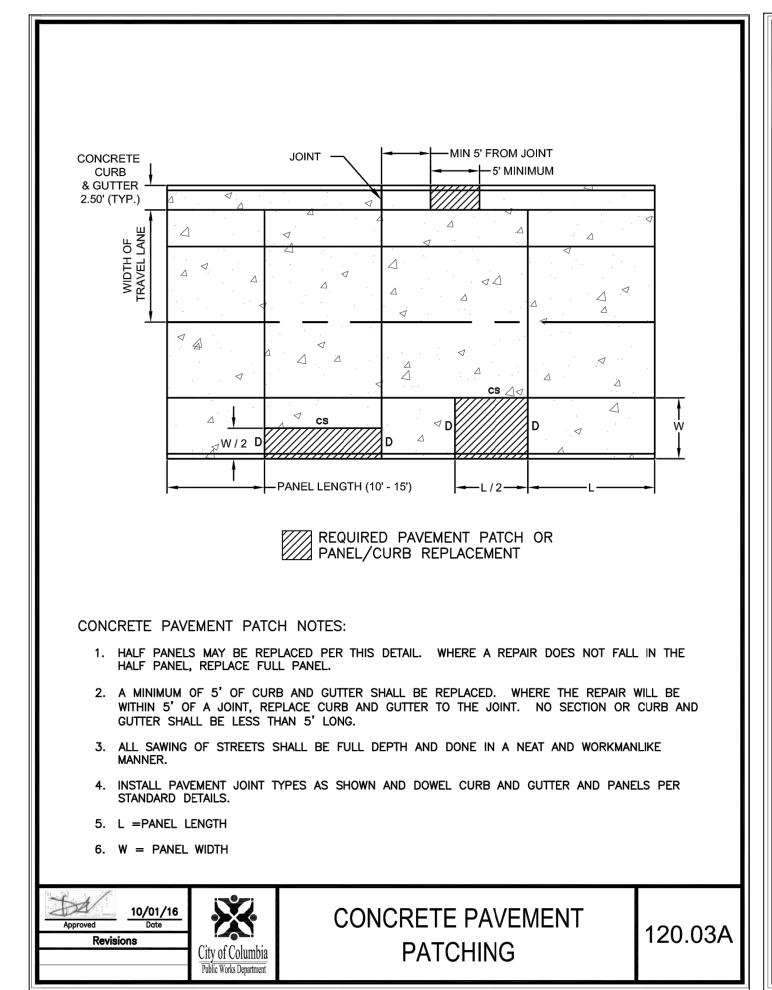

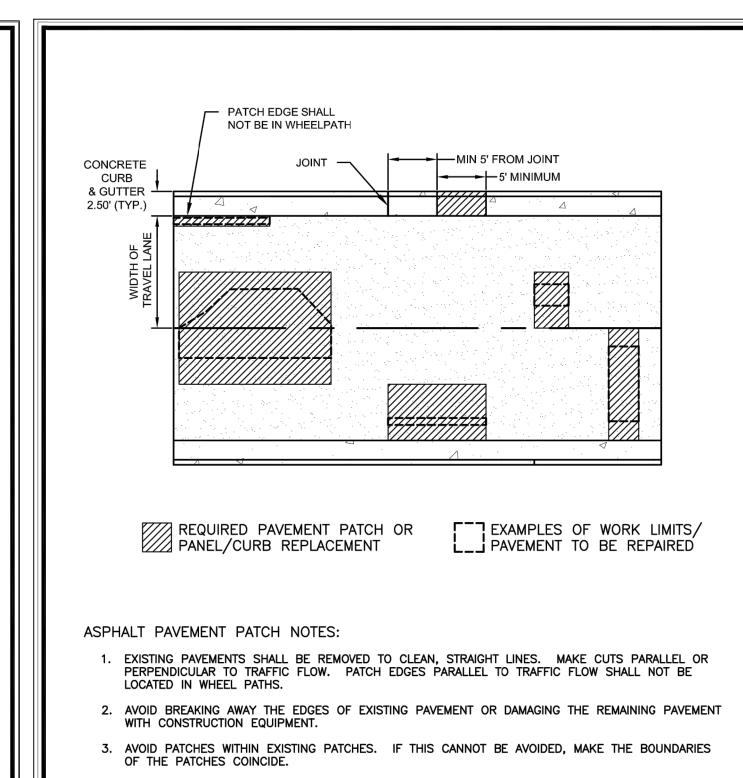



OF THE EXISTING ROADWAY.


Revisions


GUTTER SHALL BE LESS THAN 5' LONG.

ty of Columbia

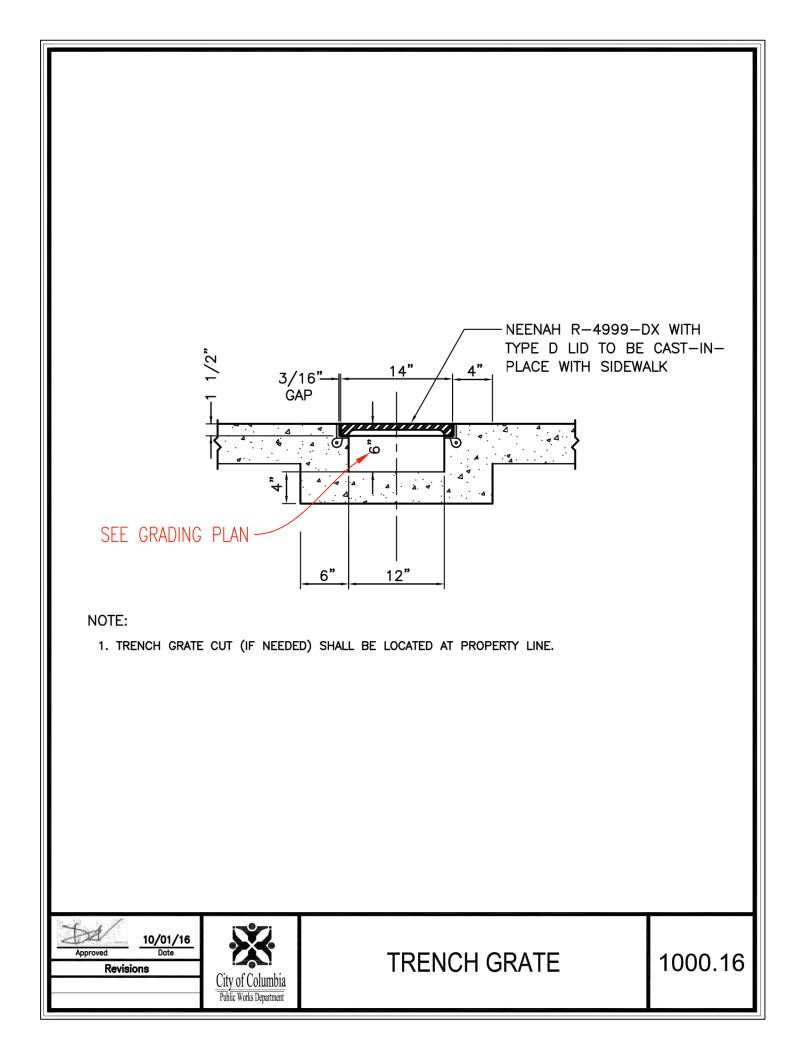

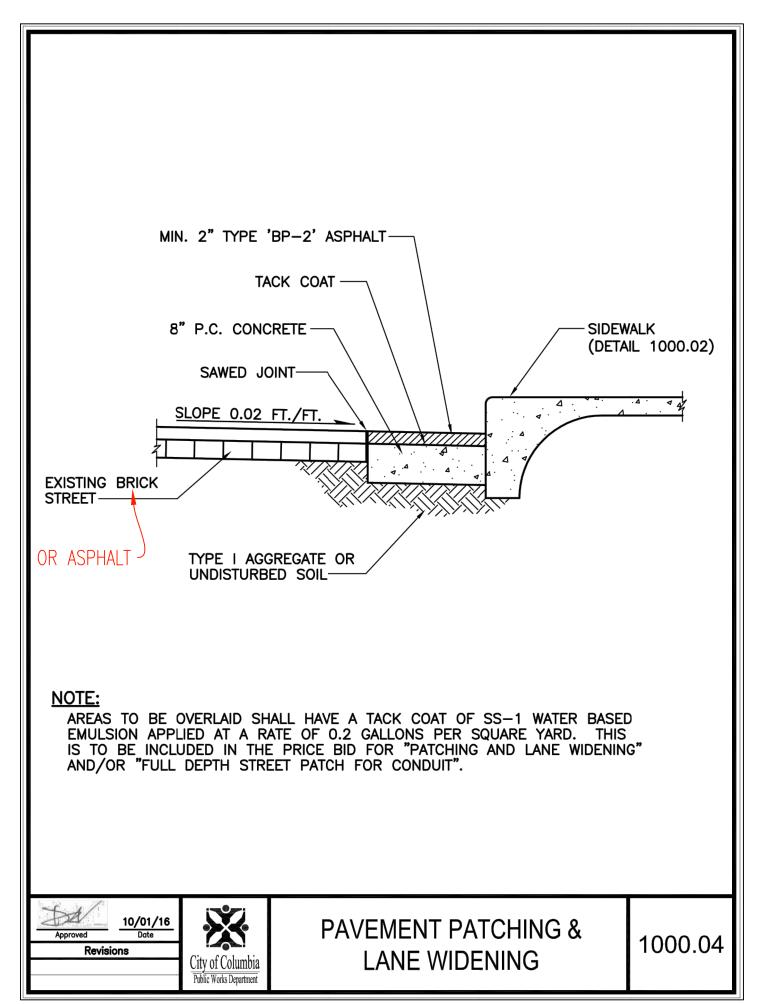


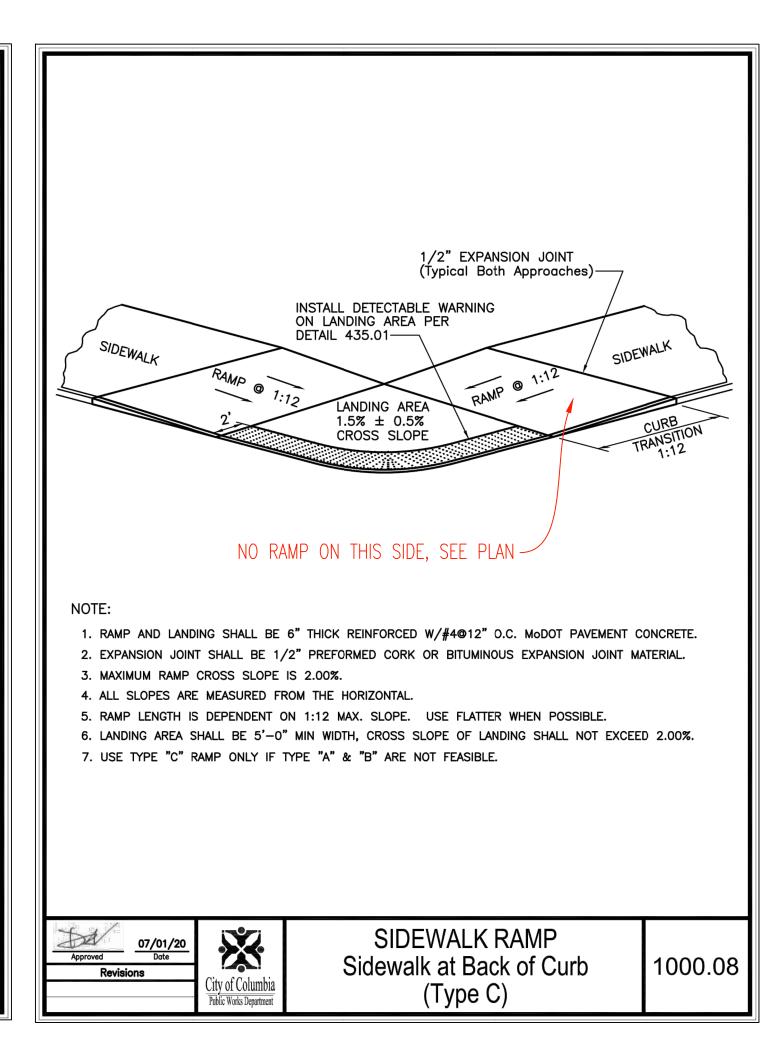

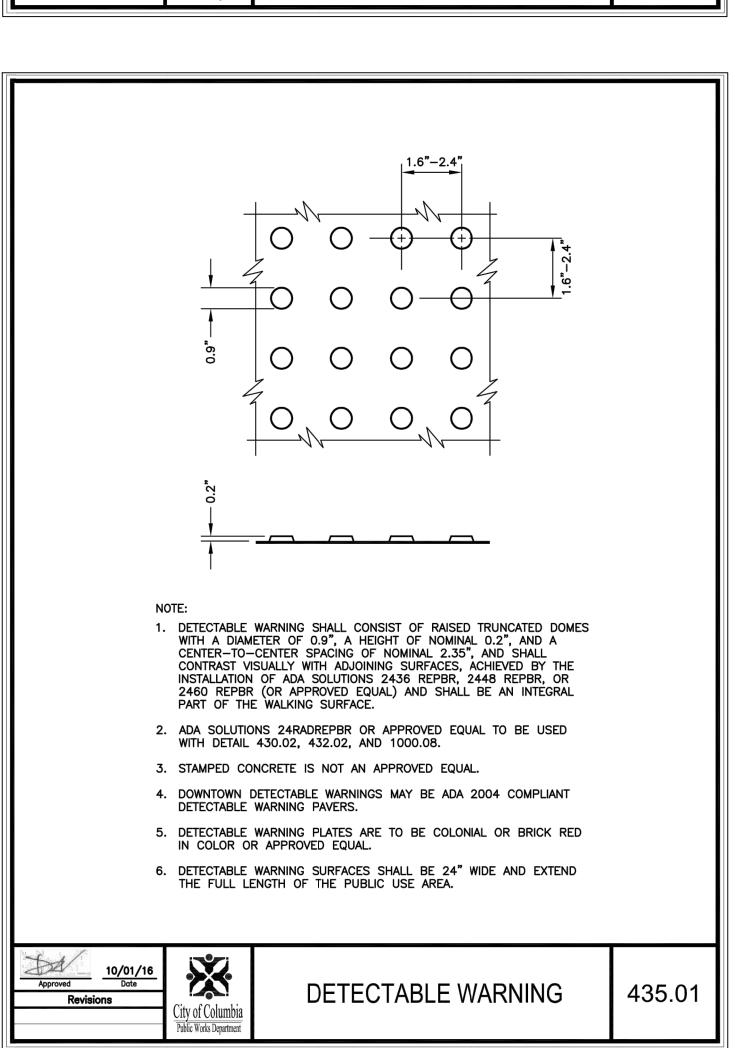

**ASPHALT PAVEMENT** 

PATCHING

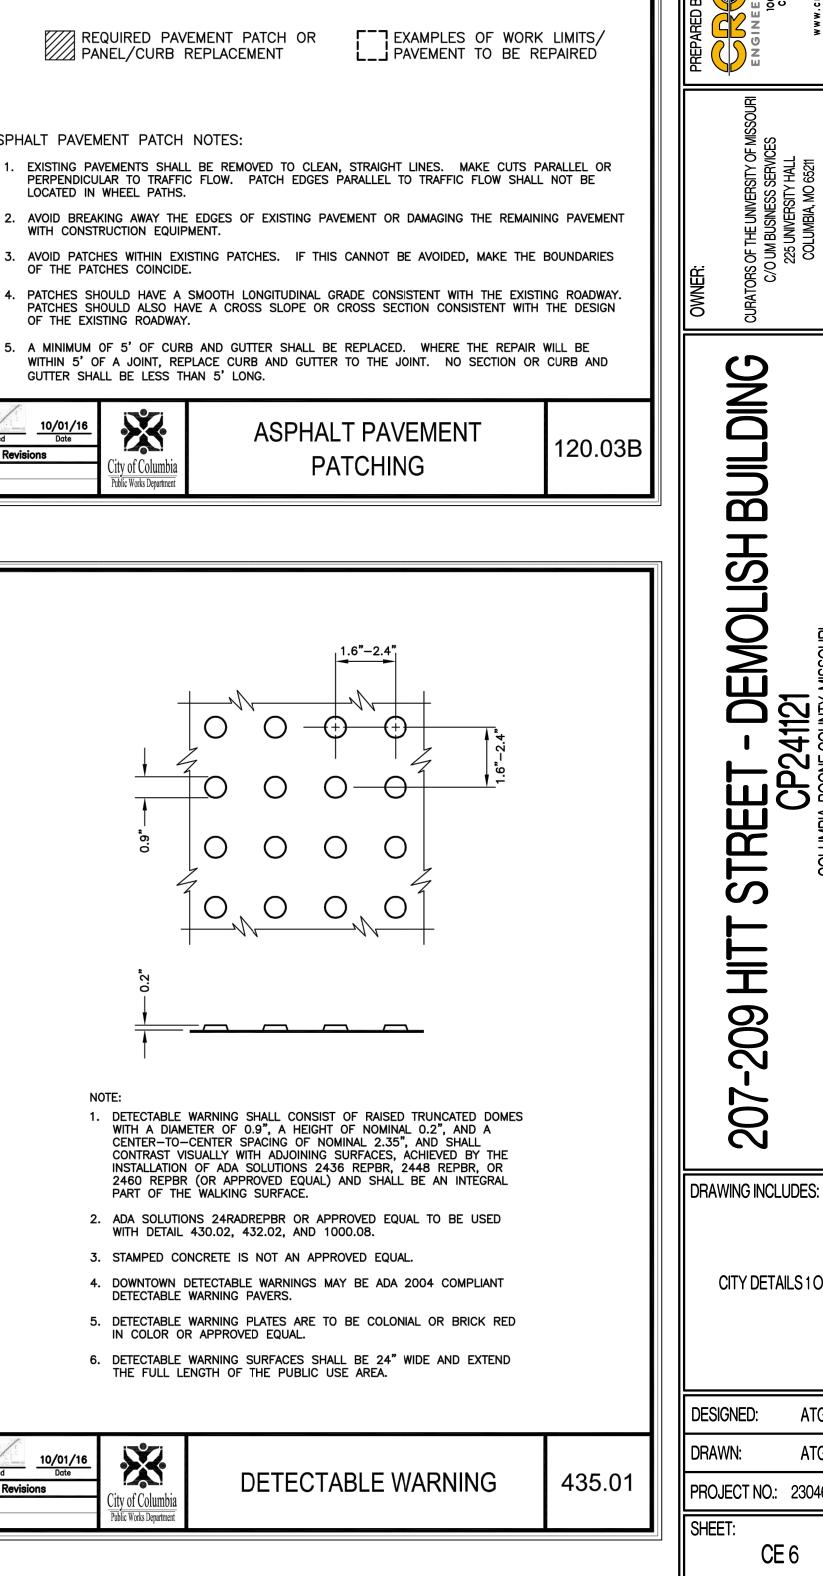


REVISIONS:

THIS SHEET HAS BEEN SIGNED, SEALED AND DATED ELECTRONICALLY

> ANDREW T. GREENE MO LICENSE-2020000043

CITY DETAILS 1 OF 2 ATG PROJECT NO.: 230464

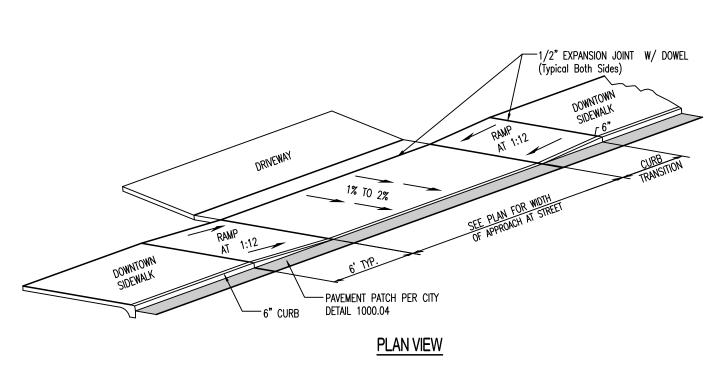

NOTES:

1. DRIVEWAY APPROACH SHALL BE 7" THICK MODOT PAVEMENT CONCRETE.
2. SEE JOINT DETAILS — 1000.03.
3. ALL DRIVEWAY APPROACHES SHALL SLOPE TOWARD THE STREET.
4. ALL DRIVEWAY APPROACHES SHALL BE CONSTRUCTED TO ACCOMMODATE SIDEWALKS. (EXISTING AND FUTURE)
5. SIDEWALK CROSS SLOPE SHALL BE INSTALLED PER CITY DETAIL 1000.02 AND SHALL INCLUDE 2' RADIUS.
7. RAMP SHALL BE 7" THICK MODOT PAVEMENT CONCRETE.
8. ALL SLOPES ARE MEASURED FROM THE HORIZONTAL.


DRIVEWAY SLOPE VARIES

1/2" EXPANSION JOINT

SECTION VIEW


SECTION VIEW

DRIVEWAY APPROACH DETAIL

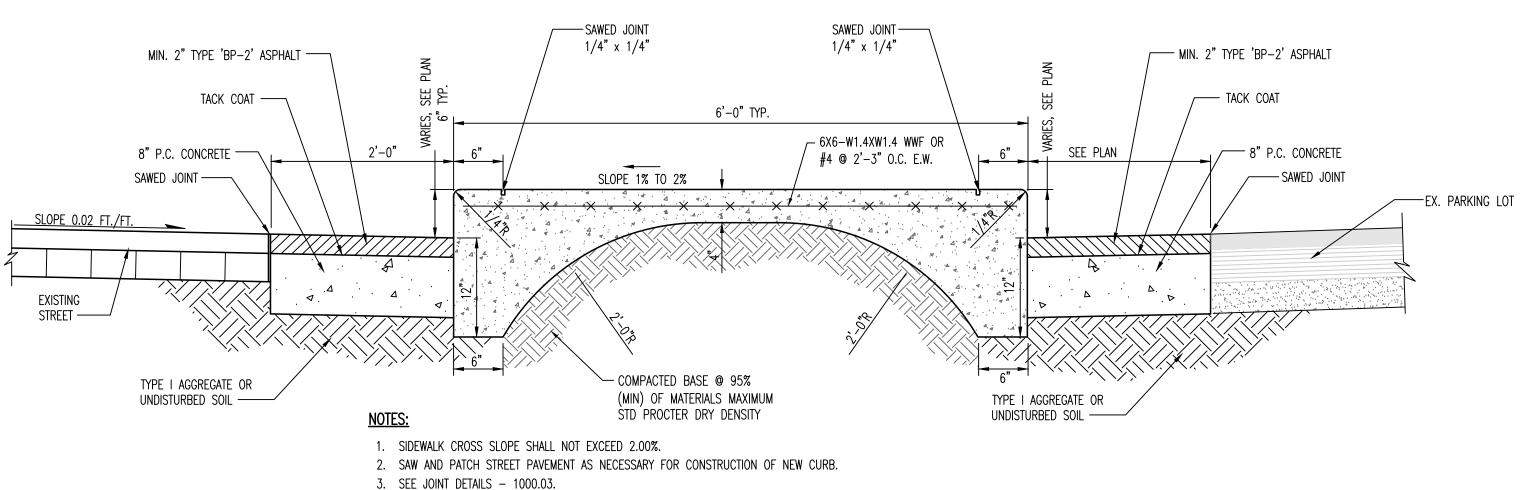

DOWNTOWN SIDEWALK

BUILDING CURATORS OF THE UNIVERSITY OF MISSO

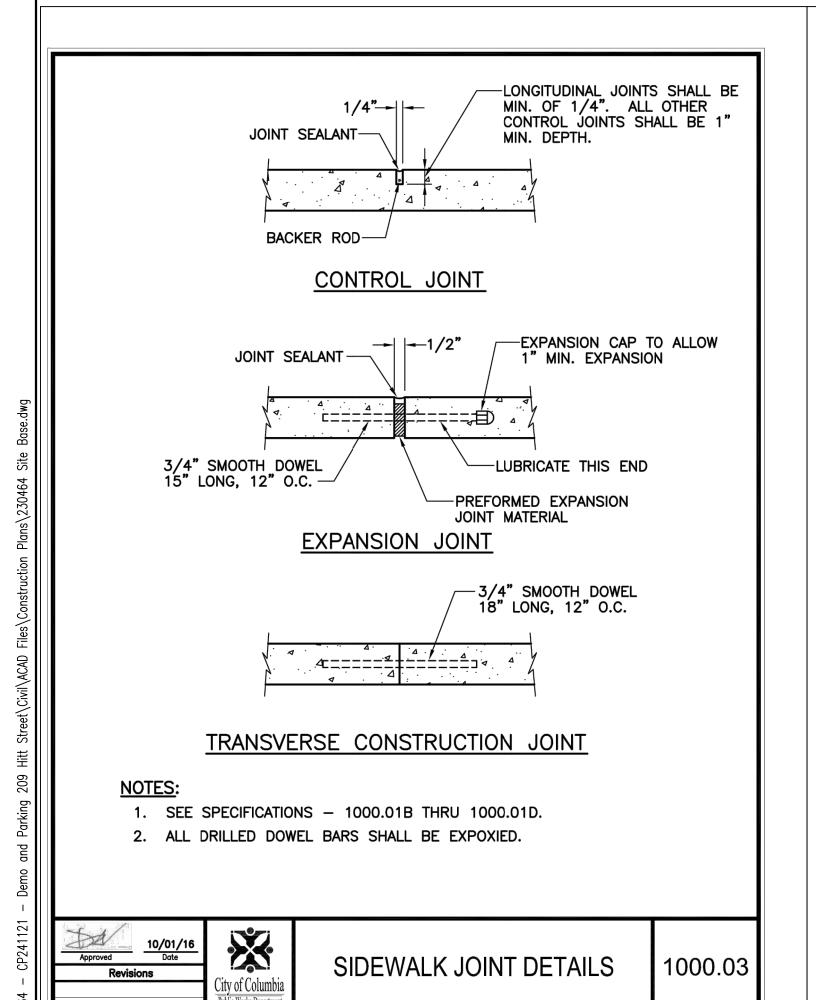

#### DOWNTOWN SIDEWALK SPECIFICATIONS

#### SC

The following Downtown Specifications and Standards are to be used for sidewalk, driveway and curb construction or replacement in the Downtown Area as outlined on drawing 1000.01A. All work within the Right of Way shall be in conformance with the City of Columbia Street and Storm Sewer Specifications and Standards, and these Downtown Sidewalk Specifications and Standards. If a conflict occurs the Downtown Sidewalk Specifications and Standards will govern.

#### CURBS

The curbs will be placed monolithically with the sidewalk and a saw joint will be provided 6-inches behind the face of the curb for the length of the curb. The curb shall extend a minimum of 6-inches above the existing pavement and 12-inches below the surface of the pavement. Drawing 1000.02 shows curb and sidewalk. Any variations from this standard must have the prior approval of the Director of Public Works.

### CONCRETE

All concrete shall be MoDOT pavement concrete.

#### SIDEWALK REMOVAL AND REPLACEMENT

Whenever sidewalk is removed and replaced, removals must be made along existing saw joints. Diagonal saw cuts and partial panel replacements are not allowed.

#### TEXTURE

The sidewalk surface texture required shall be that achieved by brooming with a stiff or medium-stiff broom. The direction of brooming shall be transverse to the long axis of the sidewalk. All edges except sawed construction joints shall be worked with an edging tool to a 1/4-inch radius.

### FINISHING OPERATIONS

Concrete finishing operations on downtown sidewalks is extremely critical. The contractor must assume the highest level of diligence in performing finishing operations to produce a high quality, durable surface.

Once the concrete has been placed, it shall be immediately struck off using a uniform strike off device free from any defects. During the strike off operation, a minimum of one inch surcharge must be maintained in front of the strike off screed. The strike off screed operations should, in most instances, seal the surface. Immediately following the strike off operation, a magnesium or aluminum bull float should be used to complete the sealing and consolidation of the surface.



This bull floating must be done prior to bleed water coming to the surface. If needed, in the Engineer's judgement, the Engineer will require a ten foot straight edge to be used immediately following the bull floating operation.

4. SEE SPECIFICATIONS - 1000.01B THRU 1000.01D.

5. NO STEEL TO BE PLACED THROUGH EXPANSION JOINT

Following the evaporation of the bleed water and when the fresh concrete will support normal foot pressure with a maximum 1/8 inch indentation, the wood floating operations should be commenced, followed by the magnesium float, and brooming with a medium bristle, high quality concrete finishing broom.

The acceptable tolerance for the surface of the sidewalk area is 1/8 inch in ten feet as determined by a ten foot straight edge checking the concrete sidewalk or other area in any direction.

#### CONTROL JOINTS

Control joints are to be sawed to a minimum depth of 1-inch. Joints shall be sawed as soon as the concrete can withstand raveling. Joints shall be cleaned and sealed immediately following sawing. Proper care must be taken to ensure that these saw joints are uniform and straight. The following guidelines will control the size of the sidewalk pads to govern the sawing:

From 0 to 6 feet wide -

no longitudinal joint is required and the traverse joint will be at even intervals equal to the width of the sidewalk.

#### From 6'1" to 10'4" -

a centerline longitudinal joint is required. A transverse saw joint is required at the same distance as
 one-half the width of the sidewalk.

#### From 10'5" and up -

the longitudinal joints will be sawed to provide a minimum of 42-inches and a maximum of 5-feet
between longitudinal saw joints. The transverse saw joint will be provided to form square sidewalk
pads. In addition, whenever poles, fire hydrants, meters, tree grates or other obstacles are
encountered, the sawing may need to be altered to control cracking at these obstacles.

### EXPANSION JOINT

Expansion joint shall be ½-inch premolded fiber conforming to ASTM D2628 or D1751 of the perforated type so that the upper ½-inch can be removed and joint sealant can be placed over the expansion joint for a uniform seal. Expansion joints shall be installed along buildings, at driveways, at ramps, at structures and at intervals not to exceed 75 feet.

Approved 10/01/16

Revisions

City

City of Columbia
Public Works Department

DOWNTOWN SIDEWALKS
Specifications

1000.010

### JOINT SEALANT

Joint sealant is required in all control, expansion and construction joints. Joint sealant shall be light gray in color. Joint sealant shall be a one or two component polysulfide polymer sealant or a one or two component polyurethane prepolymer sealant, Horn Daraseal-V or Vulkem Sealant or approved equal. Joint sealant shall be installed in accordance with manufacturer's specifications. A resilient closed cell foam backing rod, Etha Foam or approved equal, shall be used in all saw joints and placed to a depth equal to the width of the joint.

#### SIDEWALK ACCESSIBILITY

Accessible Sidewalk Ramps shall be provided at all intersections. Cross slopes of sidewalks shall not exceed 1:50. The preferred minimum downtown sidewalk width is 10 ft.

#### BLOCK OUT FOR TREES

Block outs for tree grates shall be provided in conformance with the approved downtown plan. The configuration of the block out is shown on drawings 1000.09, 1000.10A and 1000.10B. Tree grates shall be provided by the developer. Trees and soil backfill will be provided by the City.

#### TREES

Tree selection shall be in accordance with City Staff recommendations which are based on proven desirable growth characteristics for urban use areas. All tree selections must be approved by the City prior to installation.

#### <u>VAULTS</u>

When a sidewalk is constructed over a basement vault. The structural stability of the vault and sidewalk shall be analyzed by an Engineer or Architect.

#### <u>AUTHORITY</u>

The Director of Public Works shall have the authority in the interest of safety and maintenance to make technical refinements and modifications to these construction standards and methods during the time these standards are in effect.

DOWNTOWN SIDEWALKS

Specifications and Standards

**DEMOLISH** 

STRE

늘

209

207

DRAWING INCLUDES:

I REVISIONS:

THIS SHEET HAS BEEN SIGNED, SEALED AND DATED ELECTRONICALLY

ANDREW T. GREENE

MO LICENSE-2020000043

CITY DETAILS 2 OF 2

DESIGNED: ATG
DRAWN: ATG

1000.01D

PROJECT NO.: 230464

ET: **CE** 7

TRAFFIC CONTROL DEVICES SHALL COMPLY WITH THE MUTCD.

CONTRACTOR SHALL MAINTAIN A MINIMUM LANE WIDTH OF 11' AT ALL TIMES FOR ANY OPEN LANE OF TRAFFIC.

CONTRACTOR SHALL REFER TO THE CURRENT EDITION OF THE MODOT MANUAL OF TRAFFIC CONTROL FOR FIELD OPERATIONS FOR INFORMATION ON THE PROPER DEPLOYMENT OF TRAFFIC CONTROL DEVICES.

CONTRACTOR SHALL KEEP ALL ADJACENT DRIVEWAYS OPEN AT ALL TIMES.

CONTRACTOR SHALL NOTIFY CITY OF COLUMBIA COMMUNITY DEVELOPMENT THREE WEEKS PRIOR TO ANY CLOSURE MADE ACCORDING TO THIS PLAN. ALL TIMES FOR CLOSURE SHALL BE APPROVED BY THE CITY OF COLUMBIA PRIOR TO IMPLEMENTATION OF THIS PLAN.

CONTRACTOR IS RESPONSIBLE FOR NOTIFYING THE BSD RIGHT OF WAY TECHNICIAN (874-7474), IMMEDIATELY PRIOR TO CLOSURE OF STREET, DURING CONSTRUCTION FOR INSPECTIONS AND AGAIN WHEN WORK IS COMPLETE AND STREET IS REOPENED.


#### TRAFFIC CONTROL DEVICE LEGEND

SIDEWALK CLOSED AHEAD CROSS HERE

PLACE STANDARD HIGHWAY SIGN (MUTCD SIGN # R9-11L/R SHOULD READ "SIDEWALK CLOSED AHEAD CROSS HERE"). SIGN SHALL BE 24" X 18" MIN.

SIDEWALK CLOSED

PLACE STANDARD HIGHWAY SIGN (MUTCD SIGN # R9-9 SHOULD READ "SIDEWALK CLOSED"). SIGN SHALL BE 24" X 18" MIN.

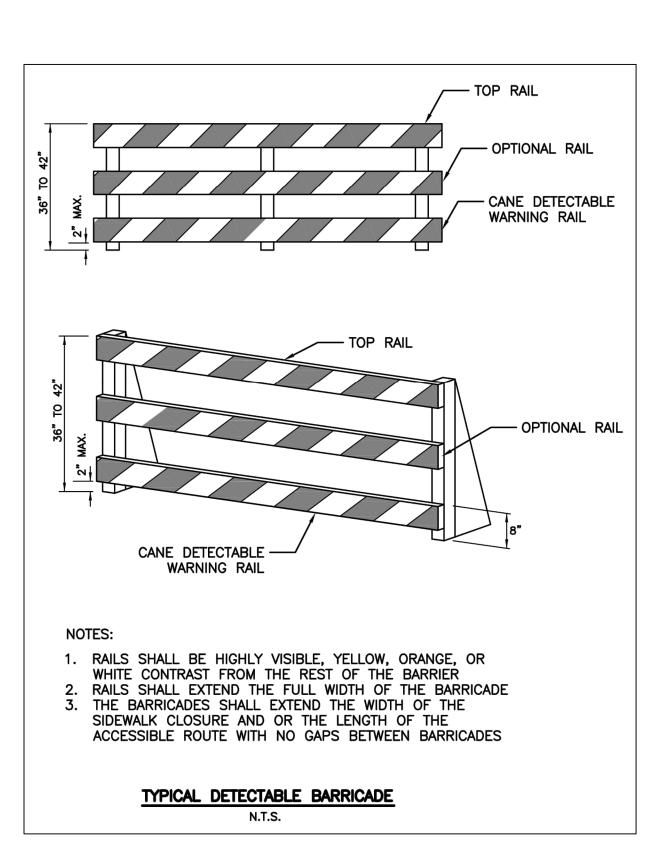



REVISIONS:

THIS SHEET HAS BEEN SIGNED, SEALED AND DATED ELECTRONICALLY

> ANDREW T. GREENE MO LICENSE-2020000043

BUILDING F STREET - DEMOLISH
CP241121
COLUMBIA, BOONE COUNTY, MISSOURI

DRAWING INCLUDES:


7-209 HITT

207

BASE BID PHASE 1 SIDEWALK **CLOSURE PLAN** 

DESIGNED:

ATG PROJECT NO.: 230464

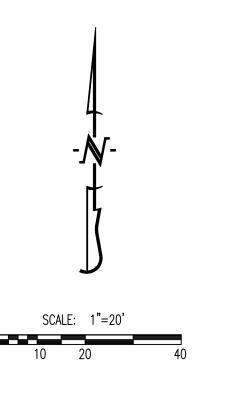

TRAFFIC CONTROL DEVICES SHALL COMPLY WITH THE MUTCD.

CONTRACTOR SHALL MAINTAIN A MINIMUM LANE WIDTH OF 11' AT ALL TIMES FOR ANY OPEN LANE OF TRAFFIC.

CONTRACTOR SHALL REFER TO THE CURRENT EDITION OF THE MODOT MANUAL OF TRAFFIC CONTROL FOR FIELD OPERATIONS FOR INFORMATION ON THE PROPER DEPLOYMENT OF TRAFFIC CONTROL DEVICES.

CONTRACTOR SHALL KEEP ALL ADJACENT DRIVEWAYS OPEN AT ALL TIMES.

CONTRACTOR SHALL NOTIFY CITY OF COLUMBIA COMMUNITY DEVELOPMENT THREE WEEKS PRIOR TO ANY CLOSURE MADE ACCORDING TO THIS PLAN. ALL TIMES FOR CLOSURE SHALL BE APPROVED BY THE CITY OF COLUMBIA PRIOR TO IMPLEMENTATION OF THIS PLAN.

CONTRACTOR IS RESPONSIBLE FOR NOTIFYING THE BSD RIGHT OF WAY TECHNICIAN (874–7474), IMMEDIATELY PRIOR TO CLOSURE OF STREET, DURING CONSTRUCTION FOR INSPECTIONS AND AGAIN WHEN WORK IS COMPLETE AND STREET IS REOPENED.

#### TRAFFIC CONTROL DEVICE LEGEND



PLACE STANDARD HIGHWAY SIGN (MUTCD SIGN # W20-1 SHOULD READ "ROAD WORK AHEAD"). SIGN SHALL BE 24" X 24" MIN.



REVISIONS:

NO. DATE

BID SET 07/18/2024

THIS SHEET HAS BEEN SIGNED, SEALED AND DATED ELECTRONICALLY

ANDREW T. GREENE MO LICENSE-2020000043

NEERING CONSULTANTS
1000 W. Nifong Blvd., Bldg. 1
Columbia, Missouri 65203
(573) 447-0292
ww.crockettengineering.com

RS OF THE UNIVERSITY OF MISSOUR!

CURATORS OF THE UN C/O UM BUSIN

207-209 HITT STREET - DEMOLISH BUILDING
CP241121
COLUMBIA, BOONE COUNTY, MISSOURI

DRAWING INCLUDES:

BASE BID PHASE 1 SOUTH SEWER TRAFFIC CONTROL PLAN

DESIGNED: ATG
DRAWN: ATG

PROJECT NO.: 230464

EET: CE 9

TRAFFIC CONTROL DEVICES SHALL COMPLY WITH THE MUTCD.


CONTRACTOR SHALL MAINTAIN A MINIMUM LANE WIDTH OF 11' AT ALL TIMES FOR ANY OPEN LANE OF TRAFFIC.

CONTRACTOR SHALL REFER TO THE CURRENT EDITION OF THE MODOT MANUAL OF TRAFFIC CONTROL FOR FIELD OPERATIONS FOR INFORMATION ON THE PROPER DEPLOYMENT OF TRAFFIC CONTROL DEVICES.

CONTRACTOR SHALL KEEP ALL ADJACENT DRIVEWAYS OPEN AT ALL TIMES.

CONTRACTOR SHALL NOTIFY CITY OF COLUMBIA COMMUNITY DEVELOPMENT THREE WEEKS PRIOR TO ANY CLOSURE MADE ACCORDING TO THIS PLAN. ALL TIMES FOR CLOSURE SHALL BE APPROVED BY THE CITY OF COLUMBIA PRIOR TO IMPLEMENTATION OF THIS PLAN.

CONTRACTOR IS RESPONSIBLE FOR NOTIFYING THE BSD RIGHT OF WAY TECHNICIAN (874–7474), IMMEDIATELY PRIOR TO CLOSURE OF STREET, DURING CONSTRUCTION FOR INSPECTIONS AND AGAIN WHEN WORK IS COMPLETE AND STREET IS REOPENED.

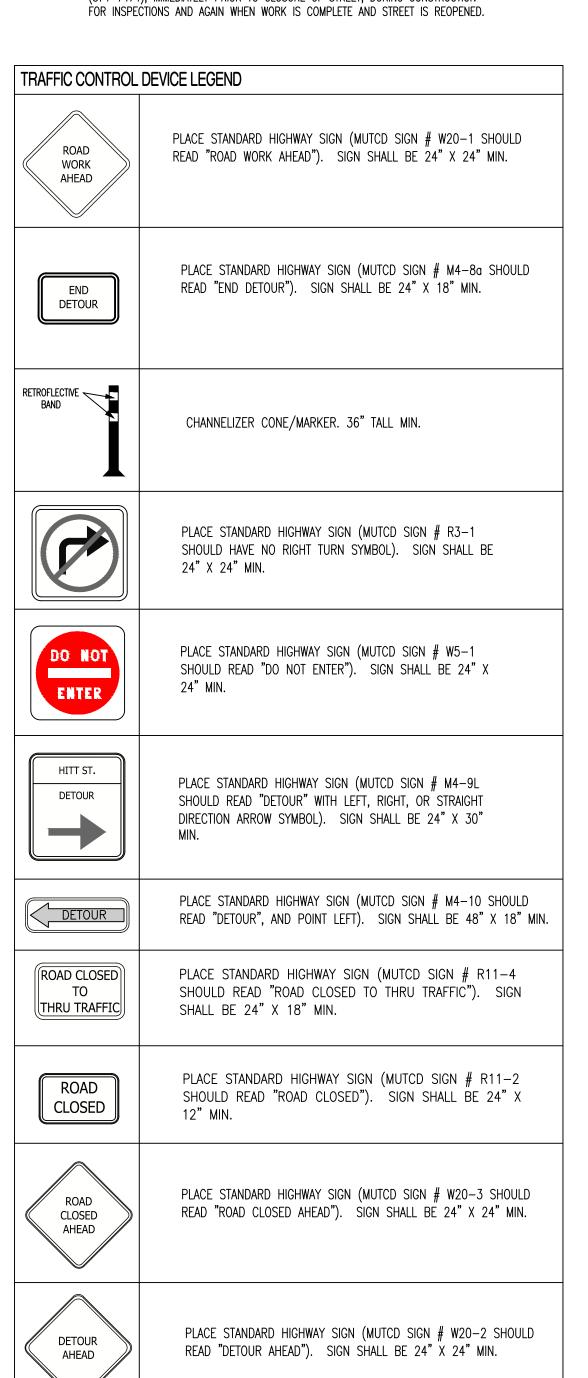



DESIGNED: ATG
DRAWN: ATG

PROJECT NO.: 230464

TRAFFIC CONTROL DEVICES SHALL COMPLY WITH THE MUTCD.


CONTRACTOR SHALL MAINTAIN A MINIMUM LANE WIDTH OF 11' AT ALL TIMES FOR ANY OPEN LANE OF TRAFFIC.


CONTRACTOR SHALL REFER TO THE CURRENT EDITION OF THE MODOT MANUAL OF TRAFFIC CONTROL FOR FIELD OPERATIONS FOR INFORMATION ON THE PROPER DEPLOYMENT OF TRAFFIC CONTROL DEVICES.

CONTRACTOR SHALL KEEP ALL ADJACENT DRIVEWAYS OPEN AT ALL TIMES.

CONTRACTOR SHALL NOTIFY CITY OF COLUMBIA COMMUNITY DEVELOPMENT THREE WEEKS PRIOR TO ANY CLOSURE MADE ACCORDING TO THIS PLAN. ALL TIMES FOR CLOSURE SHALL BE APPROVED BY THE CITY OF COLUMBIA PRIOR TO IMPLEMENTATION OF THIS PLAN.

CONTRACTOR IS RESPONSIBLE FOR NOTIFYING THE BSD RIGHT OF WAY TECHNICIAN (874–7474), IMMEDIATELY PRIOR TO CLOSURE OF STREET, DURING CONSTRUCTION FOR INSPECTIONS AND AGAIN WHEN WORK IS COMPLETE AND STREET IS REOPENED.

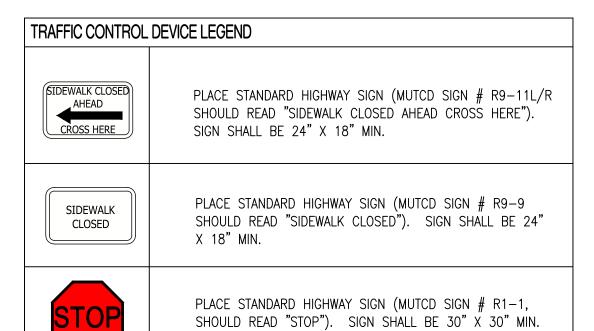

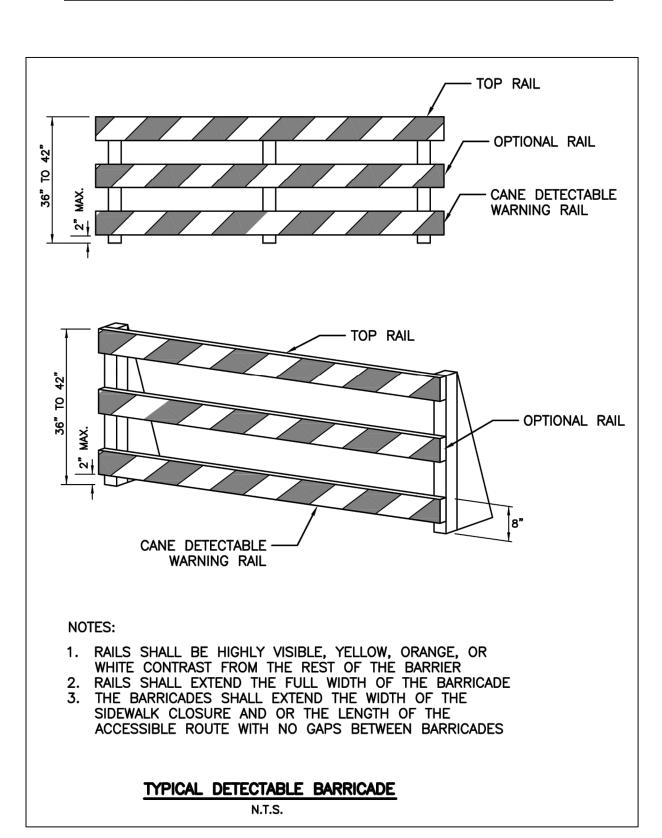



REVISIONS:

NO. DATE

RID SET. 1 07/18/2024

THIS SHEET HAS BEEN SIGNED, SEALED AND DATED ELECTRONICALLY

ANDREW T. GREENE MO LICENSE-2020000043

NEERING CONSULTANTS
1000 W. Nifong Bivd., Bidg. 1
Columbia, Missouri 65203
(373) 447-0292
ww.crockettengineering.com

NIVERSITY OF MISSOURI
LESS SERVICES
RSITY HALL
(3)
A, MO 65211

www.crock

CURATORS OF THE UNIVERSITY OF MISS
C/O UM BUSINESS SERVICES
225 UNIVERSITY HALL
COLUMBIA, MO 65211

7-209 HITT STREET - DEMOLISH BUILDING
CP241121
COLUMBIA, BOONE COUNTY, MISSOURI

DRAWING INCLUDES:

ALT#1 PHASE 2 SIDEWALK CLOSURE PLAN

DESIGNED: ATG
DRAWN: ATG

PROJECT NO.: 230464

SHEET:

TRAFFIC CONTROL DEVICES SHALL COMPLY WITH THE MUTCD.

CONTRACTOR SHALL MAINTAIN A MINIMUM LANE WIDTH OF 11' AT ALL TIMES FOR ANY OPEN LANE OF TRAFFIC.

CONTRACTOR SHALL REFER TO THE CURRENT EDITION OF THE MODOT MANUAL OF TRAFFIC CONTROL FOR FIELD OPERATIONS FOR INFORMATION ON THE PROPER DEPLOYMENT OF TRAFFIC CONTROL DEVICES.

CONTRACTOR SHALL KEEP ALL ADJACENT DRIVEWAYS OPEN AT ALL TIMES.

CONTRACTOR SHALL NOTIFY CITY OF COLUMBIA COMMUNITY DEVELOPMENT THREE WEEKS PRIOR TO ANY CLOSURE MADE ACCORDING TO THIS PLAN. ALL TIMES FOR CLOSURE SHALL BE APPROVED BY THE CITY OF COLUMBIA PRIOR TO IMPLEMENTATION OF THIS PLAN.

CONTRACTOR IS RESPONSIBLE FOR NOTIFYING THE BSD RIGHT OF WAY TECHNICIAN (874-7474), IMMEDIATELY PRIOR TO CLOSURE OF STREET, DURING CONSTRUCTION FOR INSPECTIONS AND AGAIN WHEN WORK IS COMPLETE AND STREET IS REOPENED.


#### TRAFFIC CONTROL DEVICE LEGEND

SIDEWALK CLOSED AHEAD CROSS HERE

PLACE STANDARD HIGHWAY SIGN (MUTCD SIGN # R9-11L/R SHOULD READ "SIDEWALK CLOSED AHEAD CROSS HERE"). SIGN SHALL BE 24" X 18" MIN.

SIDEWALK CLOSED

PLACE STANDARD HIGHWAY SIGN (MUTCD SIGN # R9-9 SHOULD READ "SIDEWALK CLOSED"). SIGN SHALL BE 24" X 18" MIN.

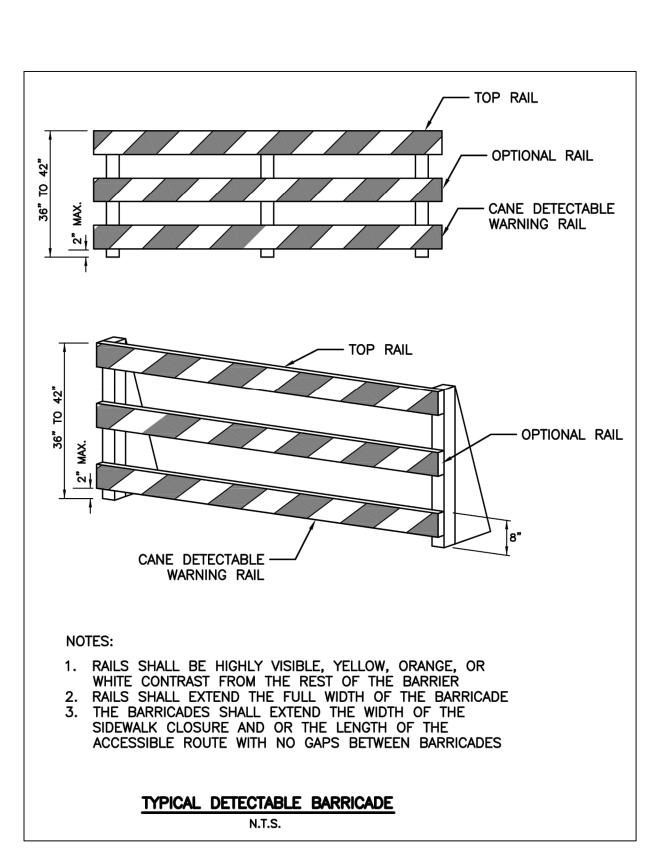



REVISIONS:

THIS SHEET HAS BEEN SIGNED, SEALED AND DATED ELECTRONICALLY

> ANDREW T. GREENE MO LICENSE-2020000043

BUILDING F STREET - DEMOLISH
CP241121
COLUMBIA, BOONE COUNTY, MISSOURI 7-209 HITT

DRAWING INCLUDES:

ALT#1 PHASE 3 SIDEWALK **CLOSURE PLAN** 

DESIGNED:

ATG PROJECT NO.: 230464

#### 1. MATERIALS

#### A. BACKFILL SOILS

a. REINFORCED STRUCTURAL BACKFILL MATERIALS SHALL BE APPROVED BY THE OWNER OR OWNER'S REPRESENTATIVE AND SHALL MEET THE STRENGTH REQUIREMENTS AS DEFINED IN SECTION 5.0. THE REINFORCED BACKFILL MATERIAL SHALL BE:

MODOT TYPE 1, TYPE 5, OR 1" CLEAN.

- b. FURTHERMORE, REINFORCED BACKFILL AND RETAINED SOIL/FILL MATERIALS SHALL BE FREE OF EXCESS MOISTURE, ROOTS, MUCK, SOD, SNOW, FROZEN LUMPS, ORGANIC MATTER OR OTHER DELETERIOUS MATERIALS. ALL ROCK PARTICLES AND HARD EARTH CLODS SHALL BE LESS THAN THREE INCHES IN THE LONGEST DIMENSION. REINFORCED BACKFILL MATERIALS WHICH DO NOT MEET THIS CRITERION SHALL BE CONSIDERED UNSUITABLE AND SHALL BE REMOVED.
- c. DRAINAGE FILL BEHIND BASKET FACE SHALL CONSIST OF CLEAN CRUSHED STONE OR CRUSHED GRAVEL (1" CLEAN).

#### B. GEOGRID REINFORCING SHALL BE STRATA GEOGRIDS AS SHOWN OR APPROVED EQUAL

#### 2. TECHNICAL REQUIREMENTS

- A. PRIOR TO CONSTRUCTION OF THE WALLS, THE GRADING CONTRACTOR SHALL CLEAR AND GRUB THE REINFORCED BACKFILL ZONE AREA, REMOVING TOP SOILS, BRUSH, SOD OR OTHER ORGANIC MATERIALS. ANY UNSUITABLE SOILS SHALL BE OVER-EXCAVATED, REPLACED AND COMPACTED WITH REINFORCED BACKFILL MATERIAL TO PROTECT SPECIFICATIONS OR OTHERWISE DIRECTED BY THE OWNER'S GEOTECHNICAL ENGINEER.
- B. THE GEOTECHNICAL ENGINEER SHALL CONFIRM THAT THE SITE HAS BEEN PROPERLY PREPARED AND THE DESIGN PARAMETERS IN SECTION 5 ARE APPROPRIATE PRIOR TO FILL PLACEMENT. A WRITTEN CONFIRMATION SHALL BE PROVIDED TO CROCKETT ENGINEERING PRIOR TO FILL PLACEMENT.
- C. FILL SHALL BE PLACED IN HORIZONTAL LAYERS NOT EXCEEDING 10 INCHES IN UNCOMPACTED THICKNESS FOR HEAVY COMPACTION EQUIPMENT. FOR ZONES WHERE COMPACTION IS ACCOMPLISHED WITH HAND OPERATED EQUIPMENT, FILL SHALL BE PLACED IN HORIZONTAL LAYERS NOT EXCEEDING 6 INCHES IN UNCOMPACTED THICKNESS. ONLY HAND-OPERATED EQUIPMENT SHALL BE ALLOWED WITHIN THREE FEET OF THE BACK FACE WALL.
- D. FILL MATERIALS SHALL BE PLACED FROM THE BACK OF THE FACING UNITS TOWARDS THE ENDS OF THE GEOGRID TO ENSURE FURTHER TENSIONING.
- E. FILL SHALL BE COMPACTED AS SPECIFIED BY PROJECT SPECIFICATIONS OR TO A MINIMUM 95 PERCENT OF THE MAXIMUM DRY DENSITY AS DETERMINED IN ACCORDANCE WITH ASTM D-698.
- F. TESTING METHODS, FREQUENCY, VERIFICATION OF MATERIAL SPECIFICATIONS, AND COMPACTION SHALL BE THE RESPONSIBILITY OF THE OWNER'S GEOTECHNICAL ENGINEER. A COPY OF THE REPORT SHALL BE PROVIDED TO CROCKETT ENGINEERING.
- G. CAP UNITS SHALL BE PERMANENTLY SECURED TO THE BLOCK UNITS USING AN OUTDOOR CONSTRUCTION ADHESIVE.

#### 3. GEOGRID PLACEMENT

- A. GEOGRID SHALL BE PLACED AT THE LOCATIONS AND ELEVATIONS SHOWN ON THE DRAWINGS.
  REINFORCED FILL ZONE LENGTH IS MEASURED FROM THE FRONT FACE OF THE WALL UNITS, EXTENDING
  TO THE END OF THE GEOGRID.
- B. GEOGRID REINFORCEMENT SHALL BE CONTINUOUS THROUGHOUT THEIR EMBEDMENT LENGTH(S).
- C. PRIOR TO PLACING FILL, THE GEOGRID MATERIALS SHALL BE PLACED IN BETWEEN BLOCK COURSES, THE SLACK REMOVED AND ANCHORED.
- D. CONSTRUCTION EQUIPMENT SHALL NOT BE OPERATED DIRECTLY ON THE GEOGRID. A MINIMUM FILL THICKNESS OF SIX INCHES IS REQUIRED FOR OPERATION OF TRACKED VEHICLES OVER THE GEOGRID. TURNING OF TRACKED VEHICLES SHOULD BE KEPT TO A MINIMUM TO PREVENT TRACKS FROM DISPLACING THE FILL AND/OR THE GEOGRID.
- E. GEOGRID SHALL BE ROLLED OUT WITH THE LONG AXIS OF THE APERTURES (MACHINE DIRECTION) PERPENDICULAR TO THE WALL FACE.
- F. A MINIMUM OF 3 INCHES OF FILL MATERIAL SHALL BE REQUIRED BETWEEN OVERLAPPING LAYERS OF GEOGRID AND FILTER FABRIC, UNLESS OTHERWISE SHOWN.

#### 4. DRAINAGE

- A. AT THE END OF EACH WORK DAY, BACKFILL SURFACE SHALL BE COMPACTED WITH A SMOOTH PLATE COMPACTOR TO MINIMIZE PONDING OF WATER AND SATURATION OF THE BACKFILL.
- B. PERMANENT SURFACE WATER DIVERSION SHALL BE AS REQUIRED AND PROVIDED BY THE OWNER OR OWNER'S REPRESENTATIVE.

#### 5. DESIGN PARAMETERS

A. DESIGN OF THE REINFORCED SOIL STRUCTURE IS BASED ON THE FOLLOWING PARAMETERS BASED ON SITE EXPOSED ROCK ENTIRE WALL SURFACE:

	EFFECTIVE FRICTION ANGLE	EFFECTIVE COHESION	MOIST UNIT WT
REINFORCED FILL	34	0	125
RETAINED SOILS	22	0	120
FOUNDATION SOILS	22	0	120
MINIMUM BEARING CAPACIT	Y 1,500 PSF		

B. DESIGN METHODOLOGY: NCMA GUIDELINES

### C. FACTOR OF SAFETY:

INTERNAL STABILITY: STATIC

MINIMUM FACTOR OF SAFETY (FOS) FOR UNCERTAINTIES = 1.5
MINIMUM FOS FOR GEOGRID PULLOUT = 1.5
MINIMUM FOS FOR CONNECTION = 1.5
MINIMUM FOS FOR FACING STABILITY = 1.5
MINIMUM FOS FOR SLIDING AT LOWEST GEOGRID = 1.5
SOIL - GEOGRID INTERACTION COEFFICIENT = 0.8

#### D. EXTERNAL STABILITY

MINIMUM FACTOR OF SAFETY FOR OVERTURNING = 2.0
MINIMUM FACTOR OF SAFETY FOR SLIDING = 2.0

PERCENT COVERAGE OF GEOGRID = 100%

#### E. SURCHARGE LOADING

PARKING LOT 100 PSF

#### 6. SPECIAL PROVISIONS

- A. THE DESIGN PRESENTED HEREIN IS BASED ON SOIL PARAMETERS, FOUNDATION CONDITIONS, GROUNDWATER CONDITIONS, AND LOADINGS STATED IN SECTION 5.
- B. WALL ELEVATION VIEWS AND LOCATIONS AND GEOMETRY OF EXISTING STRUCTURES AND GRADE ABOVE AND BELOW WALLS MUST BE VERIFIED BY THE CONTRACTOR, TO MATCH ELEVATIONS SHOWN IN THE CONTRACT DOCUMENTS, PRIOR TO CONSTRUCTION.
- C. THE ENGINEER OF RECORD IS RESPONSIBLE FOR THE SEGMENTED RETAINING WALL & REINFORCED SOIL IN ITS FINAL CONDITION ONLY. GLOBAL STABILITY, BEARING CAPACITY, AND SETTLEMENT ANALYSIS IS THE RESPONSIBILITY OF THE OWNER'S GEOTECHNICAL ENGINEER. ANY CHANGES TO THE WALL REQUIRED BASED ON THE GEOTECHNICAL ANALYSIS SHOULD BE COORDINATED BY THE GEOTECHNICAL ENGINEER PRIOR TO WALL CONSTRUCTION.
- D. REFER TO BLOCK MANUFACTURE'S WRITTEN INSTALLATION INSTRUCTIONS FOR SEGMENTED RETAINING WALL INSTALLATION, SPECIFICALLY REGARDING CONNECTIONS FROM BLOCK TO BLOCK AND GEOGRID INSTALLATION.
- E. THE SOIL DESIGN PARAMETERS STATED IN SECTION 5.0 SHALL BE VERIFIED BY THE PROJECT GEOTECHNICAL ENGINEER. WRITTEN VERIFICATION OF DESIGN PARAMETERS SHALL BE SUBMITTED TO CROCKETT ENGINEERING AND PRIOR TO COMMENCING WITH CONSTRUCTION.
- F. ANY REVISIONS TO DESIGN PARAMETERS STATED IN SECTION 5.0 OR STRUCTURE GEOMETRY SHALL REQUIRE DESIGN MODIFICATIONS PRIOR TO PROCEEDING WITH CONSTRUCTION.

#### 7. GUARDRAIL SPEC

- A. SHALL BE 42" TALL ABOVE ADJACENT WALKING SURFACE.
- B. SHALL NOT HAVE OPENINGS LARGE ENOUGH TO PASS A 4" SPHERE.
- C. MAIN RAILS SHALL RESIST 50 POUND PER LINEAL FOOT LATERALLY AT THE TOP RAIL OR 200 POUNDS CONCENTRATED LOAD LATERALLY.
- D. INTERMEDIATE RAILS SHALL RESIST A CONCENTRATED LOAD OF 50 POUNDS LATERALLY.
- E. REFER TO VINYL COATED CHAIN LINK FENCE SPECIFICATION.

REVISIONS:

No. Date

BID SET 07/18/2024

THIS SHEET HAS BEEN SIGNED, SEALED AND DATED ELECTRONICALLY

GREGORY L. LINNEMAN - PE MO LICENSE - 2005001013

INGINEERING CONSULTAN
1000 W. Nifong Blvd., Bldg. 1
Columbia, Missouri 65203
(573) 447-0292

w w w.crockettengineering.co

CURATORS OF THE UNIVERSITY OF MISSOURI C/O UM BUSINESS SERVICES 225 UNIVERSITY HALL COLUMBIA, MO 65211

LISH BUILDING

EET - DEMOLISH | CP241121

HITT STREET
CP2

DRAWING INCLUDES:


209

GENERAL STRUCTURAL DATA

DESIGNED: GLL
DRAWN: SEH
PROJECT NO.: 230464

SHEET:

RW1

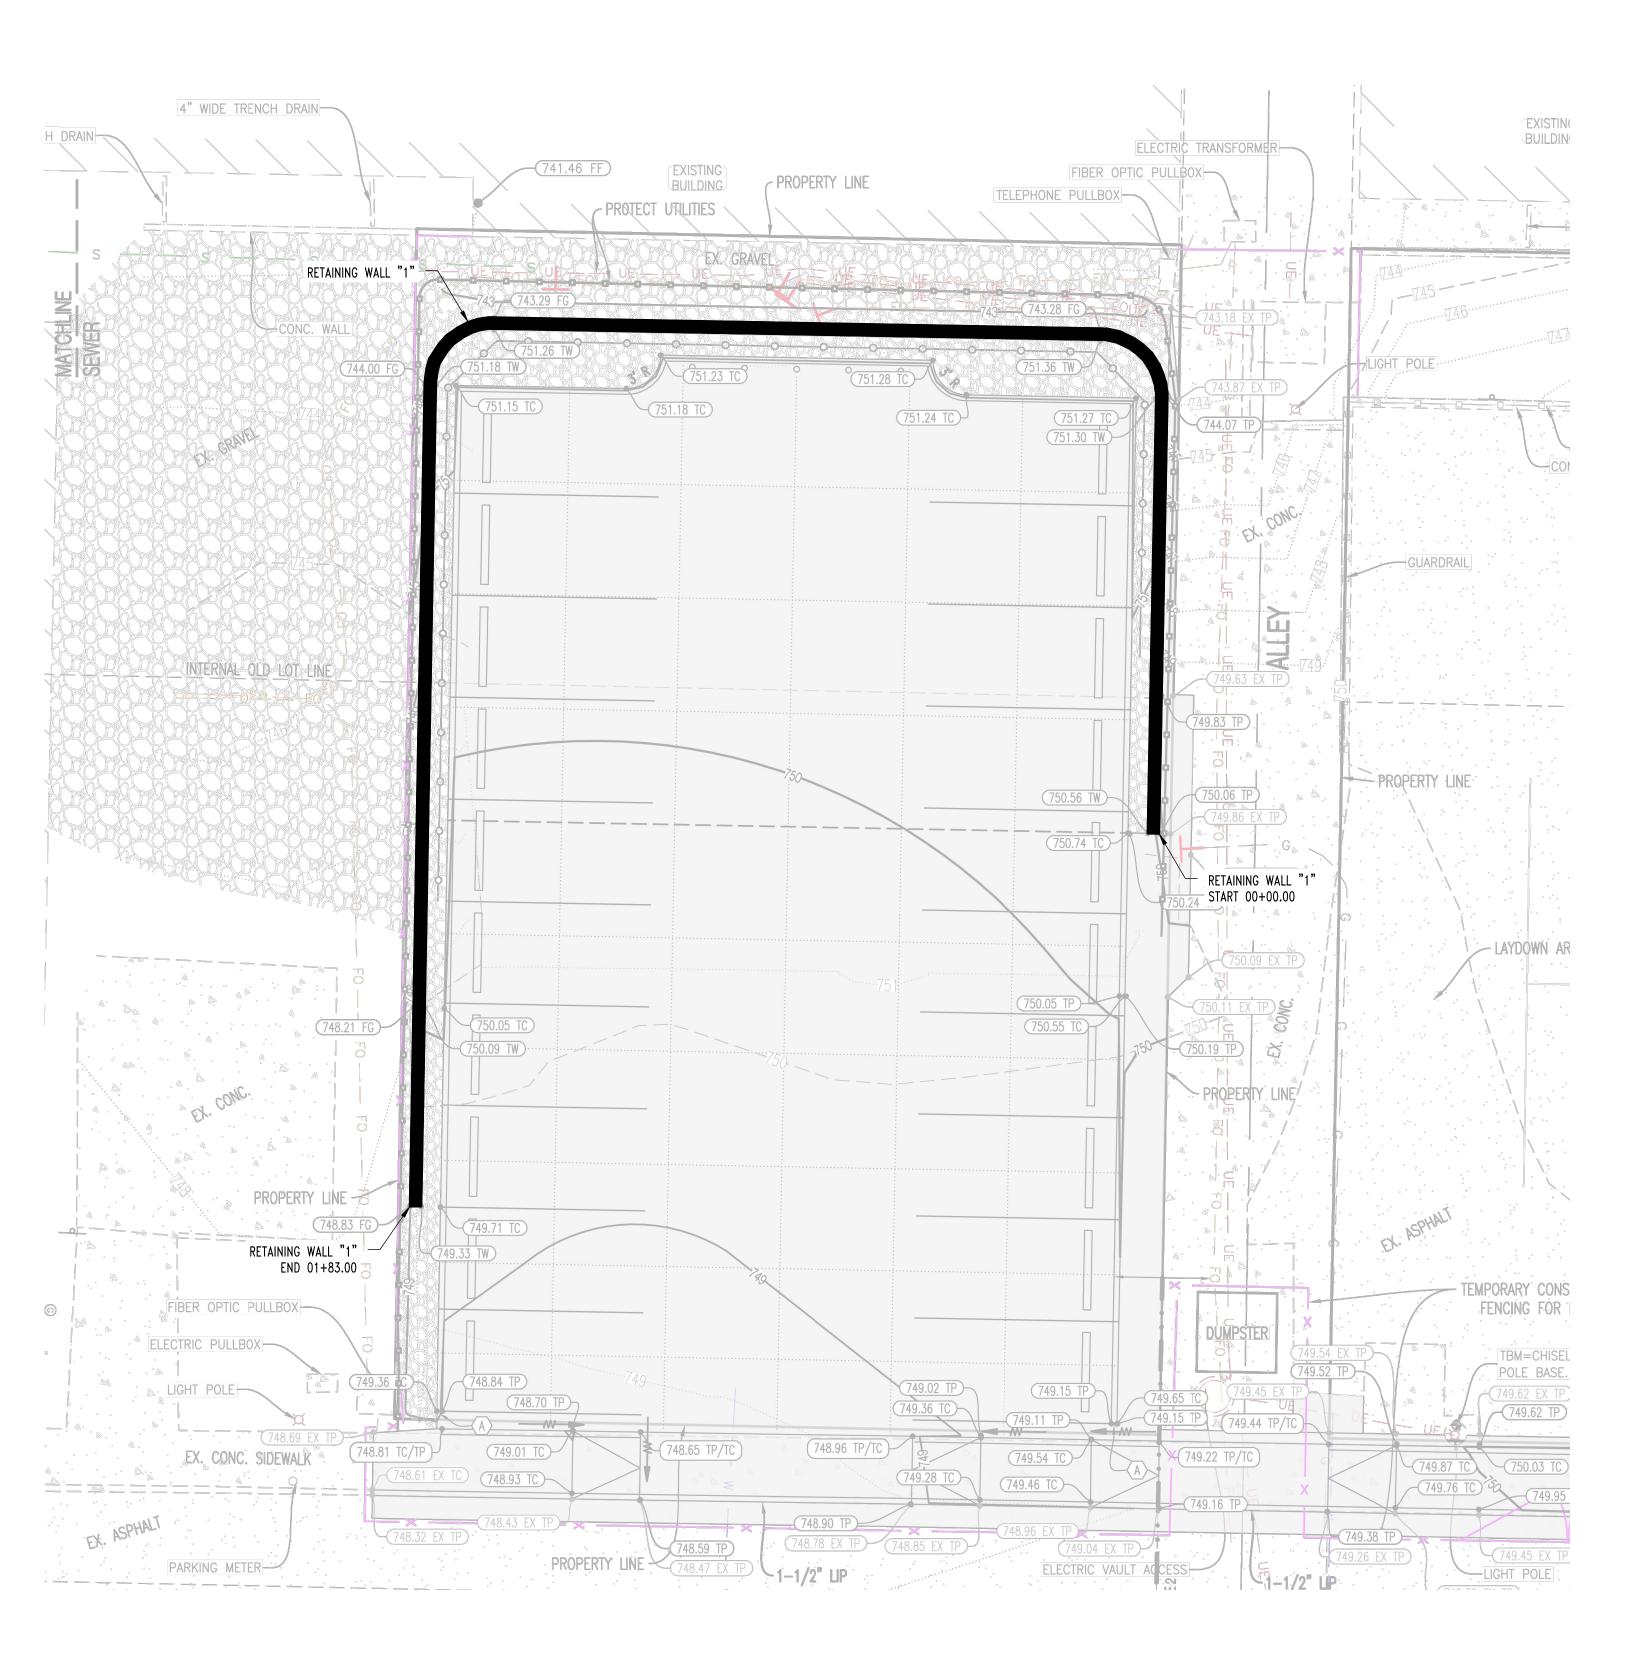

RETAINING WALL "1" PLAN

NOT TO SCALE

RW2

STRUCTURAL ENGINEER:

No. Date

BID SET 07/18/2054

ENGINE ERING CONSULTANTS

10000 W. Nifong Bivd., Bidg. 1

Columbia, Missouri 65203

WWW.Crockettengineering.com

Crockettengineering.com

Crockettengineering.com

Alsouri Certificate of Authority

#2000151301

CURATORS OF THE UNIVERSITY OF MISSOURI
C/O UM BUSINESS SERVICES
225 UNIVERSITY HALL
COLUMBIA, MO 65211

STREET - DEMOLISH BUILDING
CP241121
COLUMBIA, BOONE COUNTY, MISSOURI

207-209 HITT STREET - DE CP241121 COLUMBIA, BOONE COUNTY, M

DRAWING INCLUDES:

RETAINING WALL PLAN

DESIGNED: GLL


DRAWN: SEH

PROJECT NO.: 230464


SHEET:

RW2


PLAN NORTH

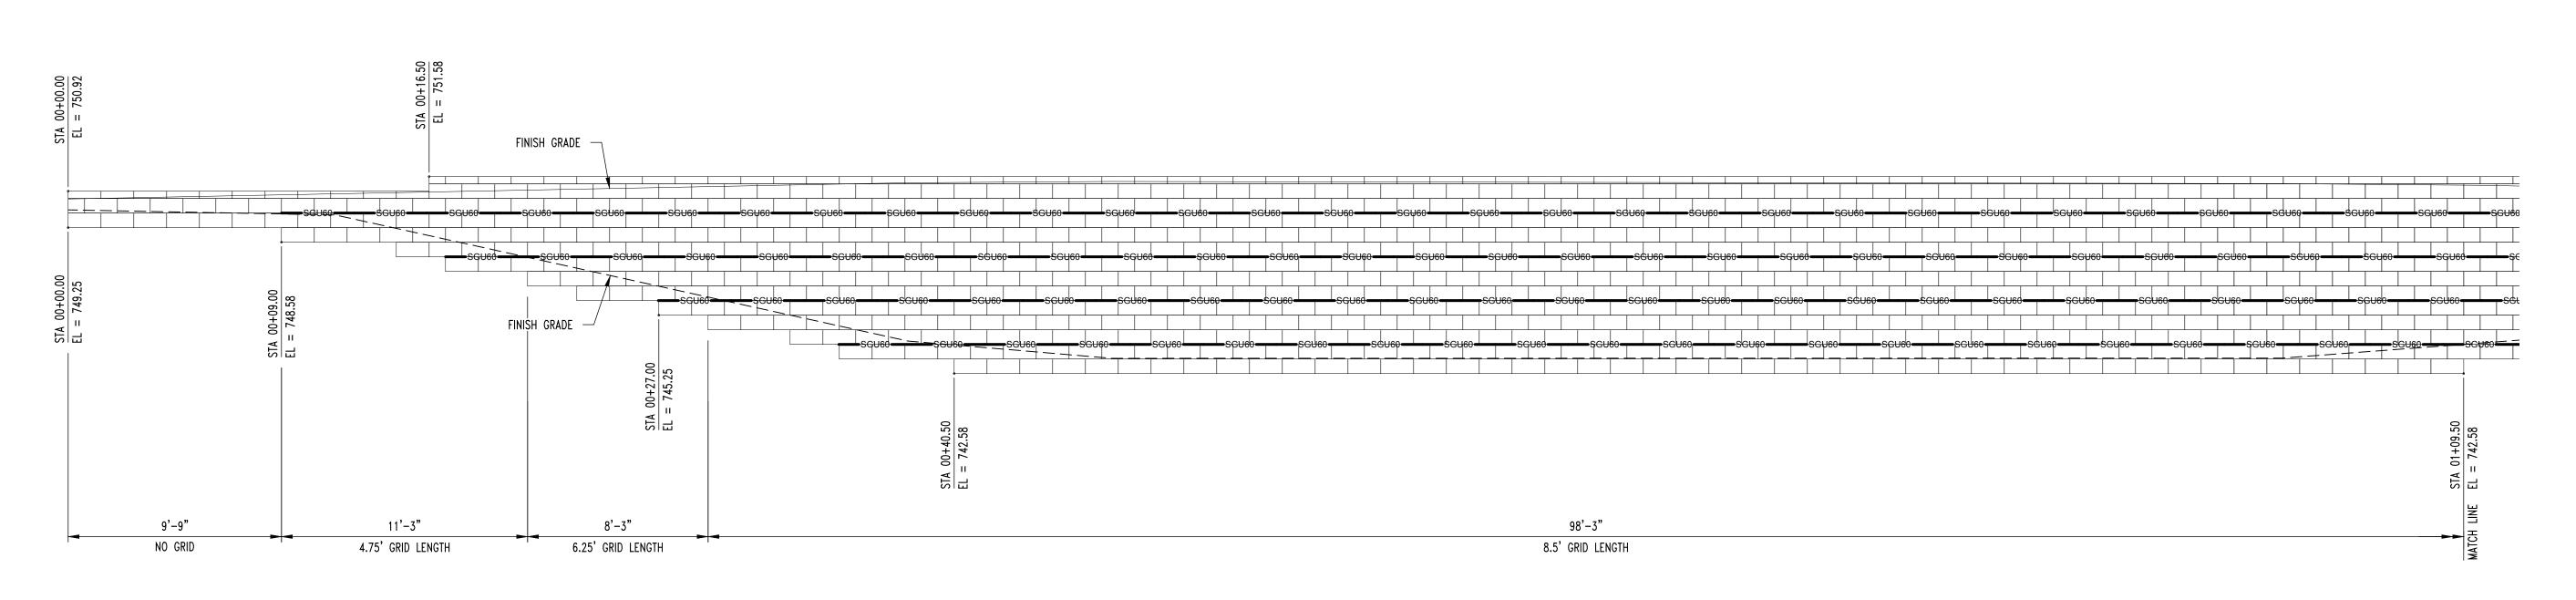



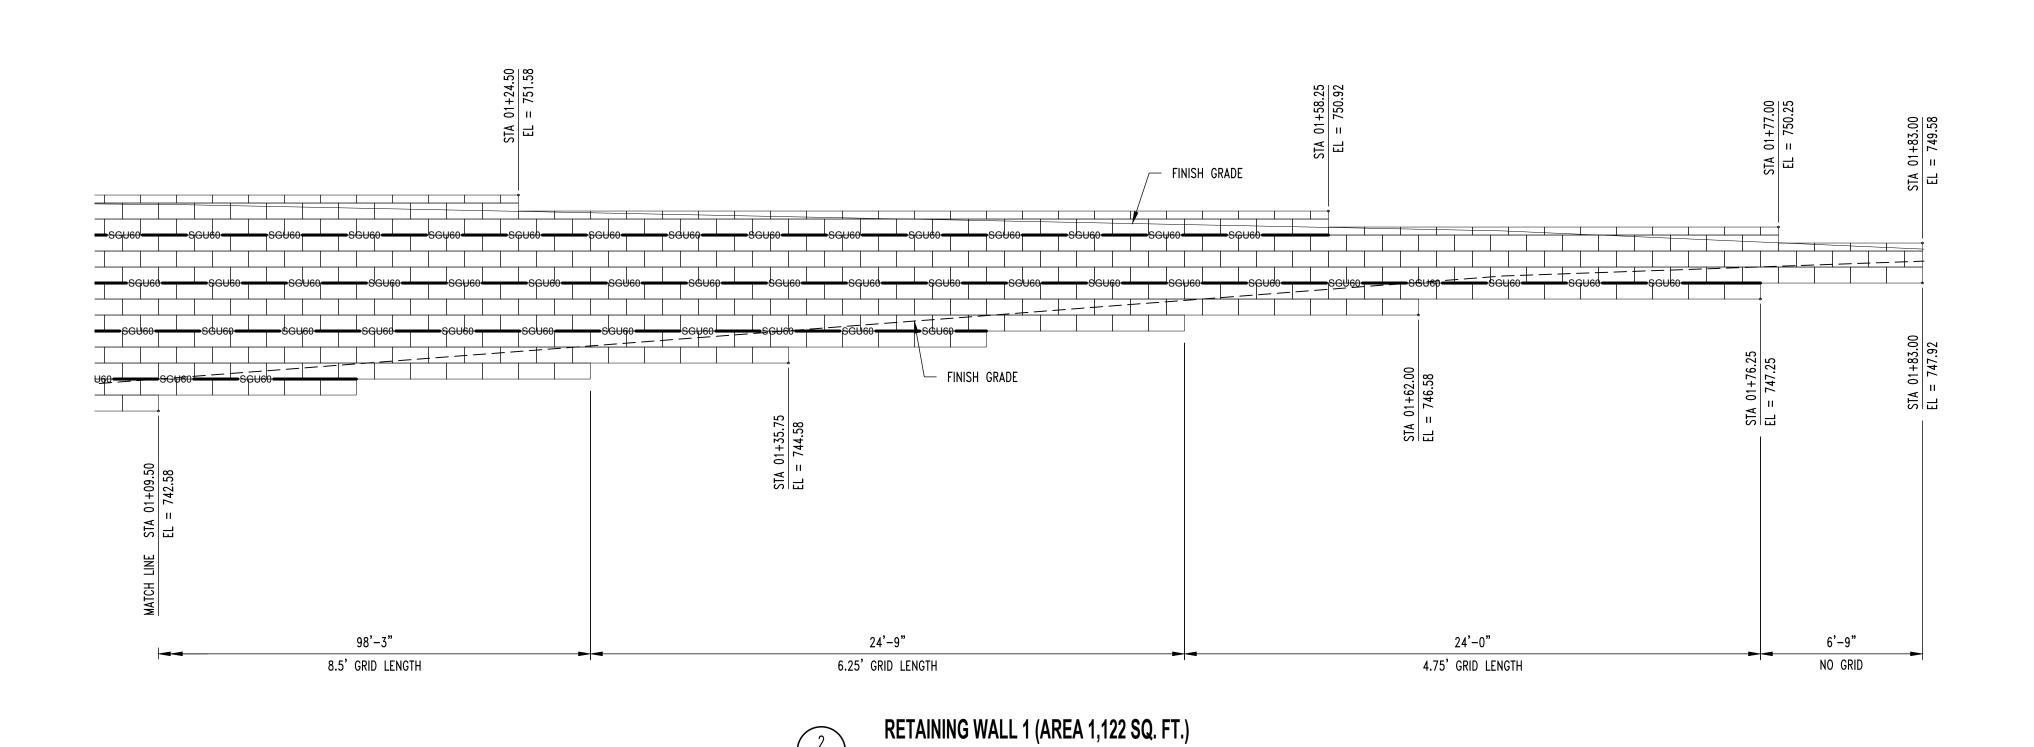

SCALE:  $\frac{1}{4}$ " = 1'-0"

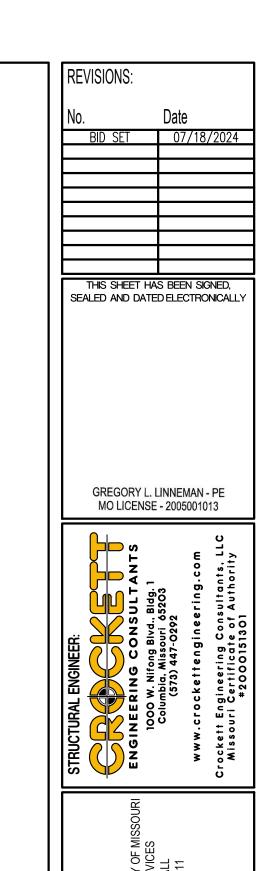


SH BULDING CURATORS OF THE UN C/O UM BUSIN 225 UNIVE COLUMBIA

207-209 HITT STREET - DEMOLISH BU CP241121
COLUMBIA, BOONE COUNTY, MISSOURI

RETAINING WALL
PROFILE

DESIGNED:	GLL	
DRAWN:	SEH	
PROJECT NO.:	230464	
SHEET:		
RW3		

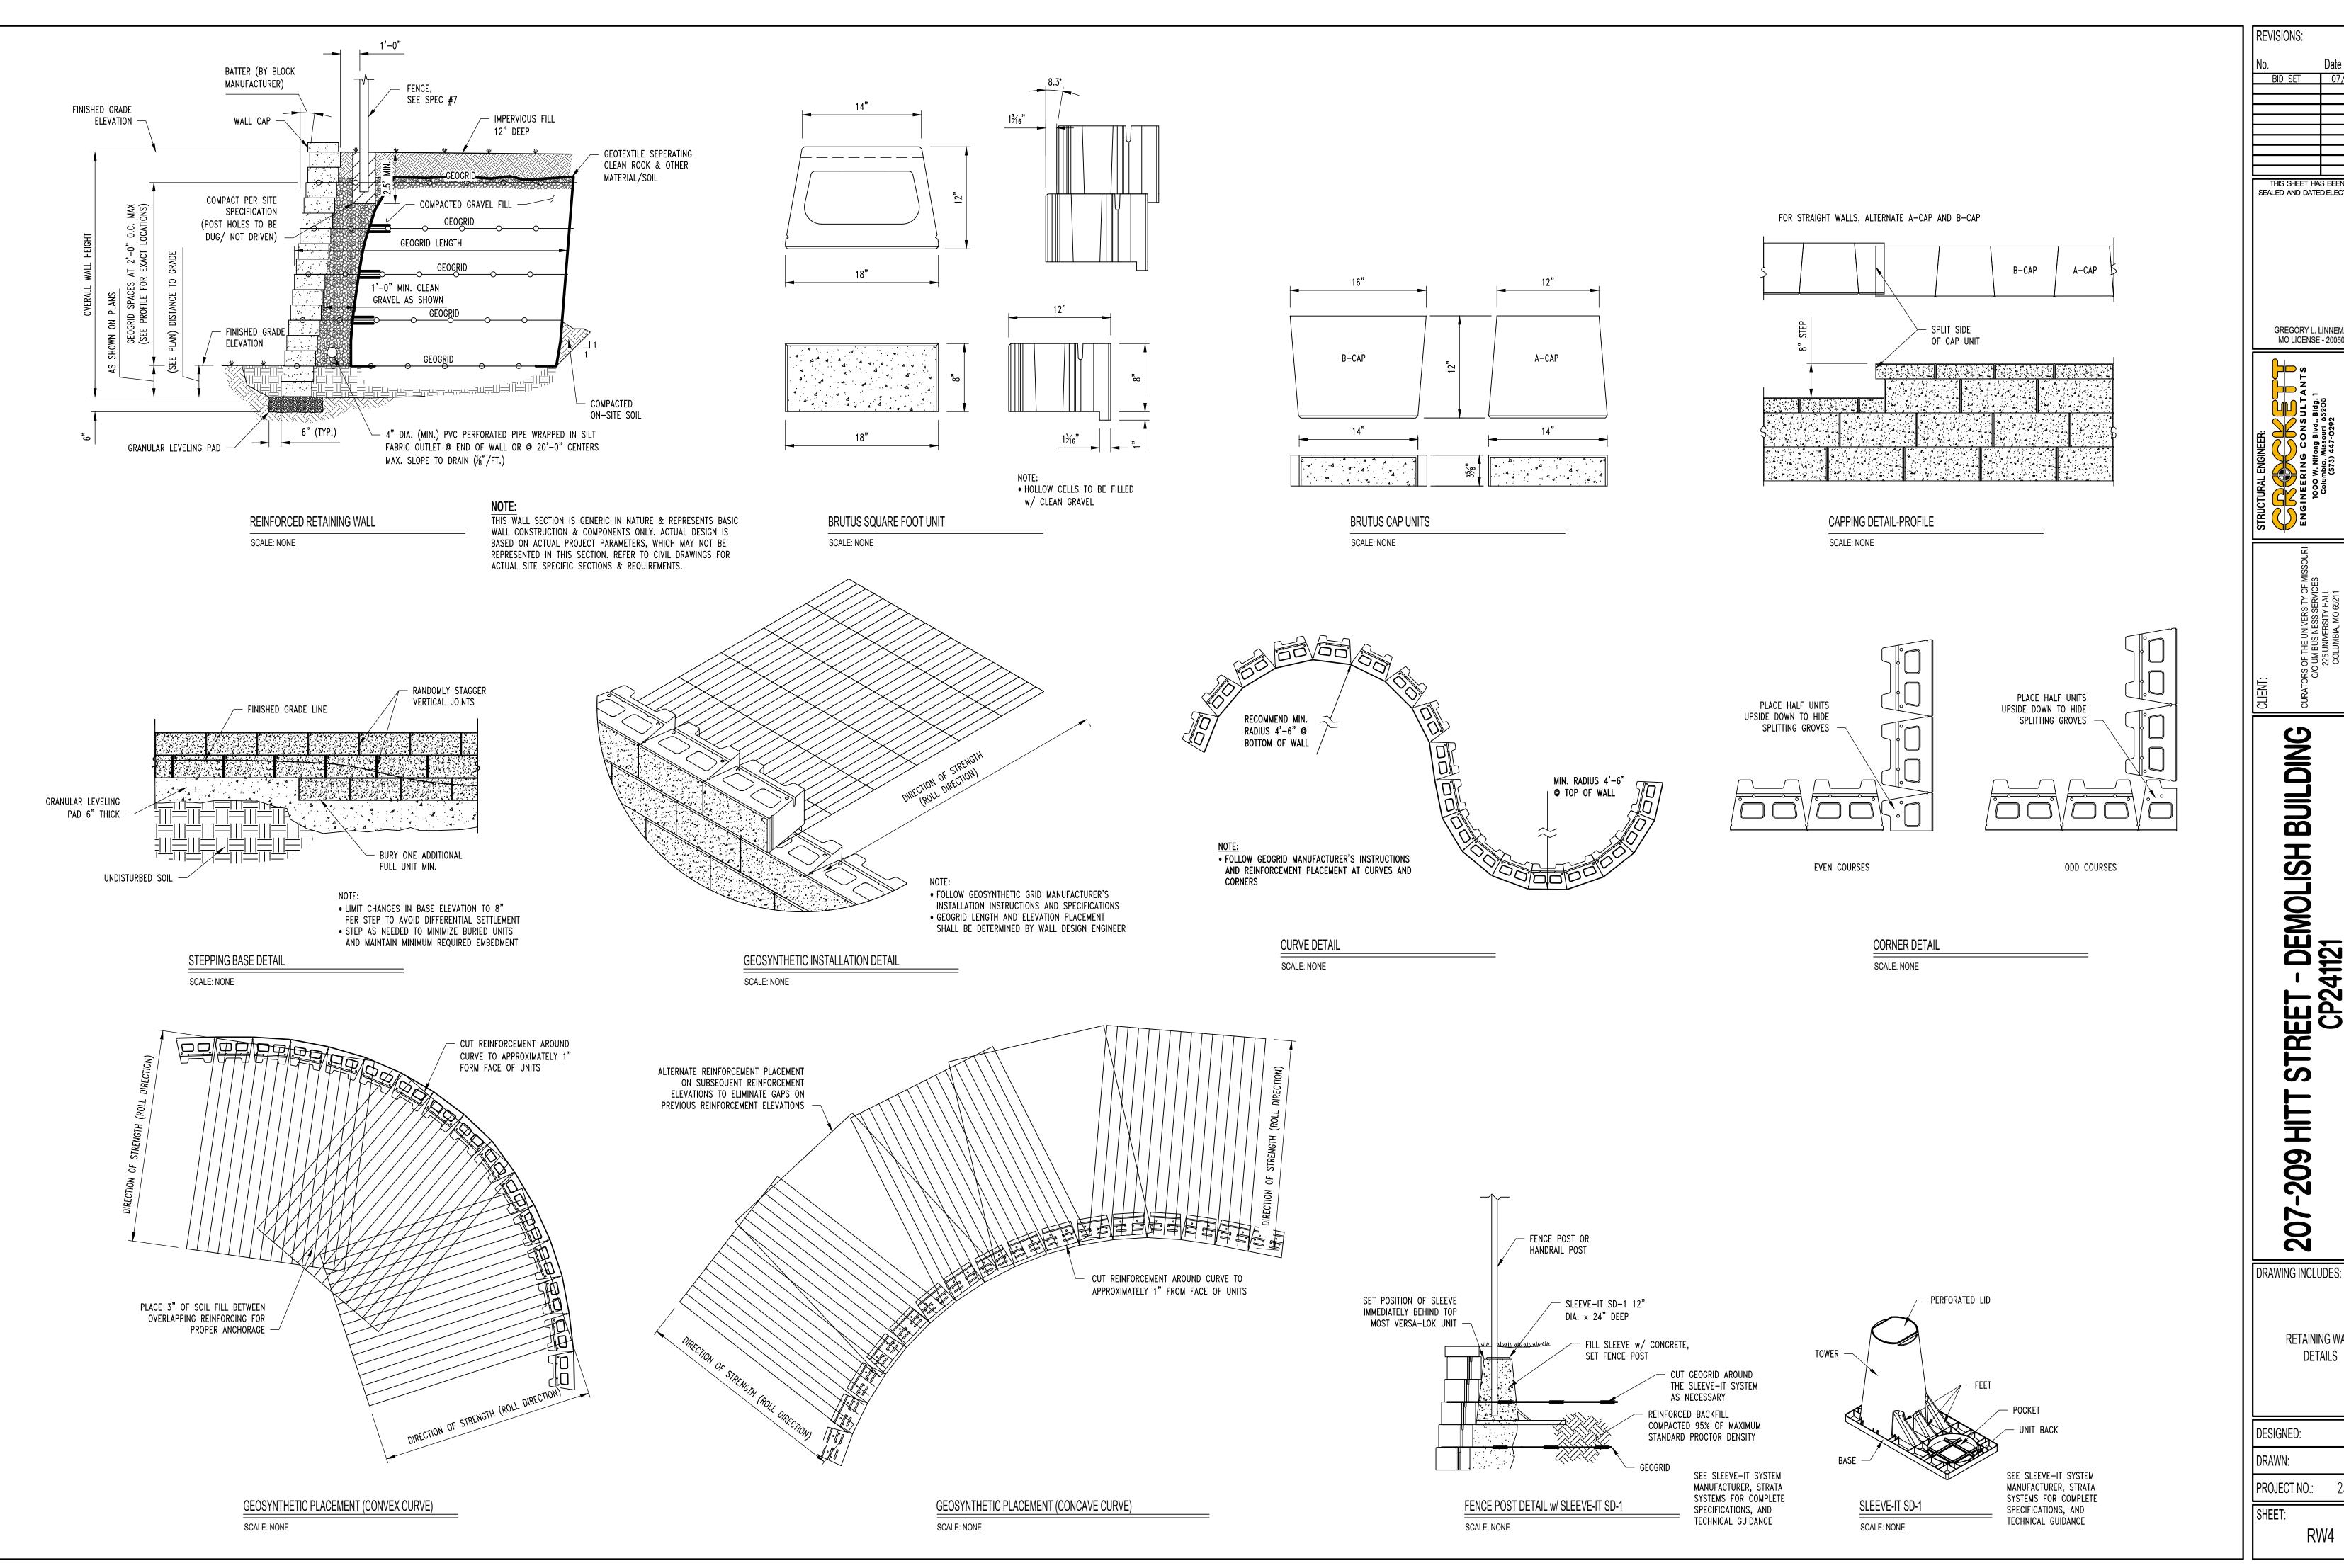

THIS SHEET HAS BEEN SIGNED, SEALED AND DATED ELECTRONICALLY

GREGORY L. LINNEMAN - PE MO LICENSE - 2005001013

**UILDING** T - DEMOLISH 1

STREE 209

DRAWING INCLUDES:

RETAINING WALL

SEH 230464